



**SMOKE ALARMS**  
**City of Grand Rapids**  
**Building Safety Division**  
**218-326-7601**

[www.cityofgrandrapidsmn.com](http://www.cityofgrandrapidsmn.com)




This handout is intended only as a guide and is based in part on the 2015 Minnesota State Building Code, Grand Rapids City ordinances, and good building practice. While every attempt has been made to insure the correctness of this handout, no guarantees are made to its accuracy or completeness. Responsibility for compliance with applicable codes and ordinances falls on the owner or contractor. For specific questions regarding code requirements, refer to the applicable codes or contact your local Building Safety Division.

### **New Construction**

In newly constructed dwellings, smoke alarms must be installed in each sleeping room, outside of each sleeping area in the immediate vicinity of the bedrooms, and on each story of the dwelling including basements. Smoke alarms must be interconnected in such a manner that the actuation of one alarm will activate all of the alarms in the dwelling unit. Smoke alarms must receive their primary power from the building wiring but must have a battery backup. Circuits containing smoke alarms are not permitted to have a disconnecting switch other than those required for overcurrent protection.

### **Remodeled or Altered Dwellings**

Smoke alarms must be installed in existing dwellings to meet the requirements for new dwellings whenever *interior* alterations, repairs or additions requiring a permit occur or when one or more bedrooms are added. The alarms are required to be hardwired and interconnected and equipped with a battery backup. However, in existing portions of the building, alarms can be solely battery operated where the work does not involve removal of wall or ceiling finishes.

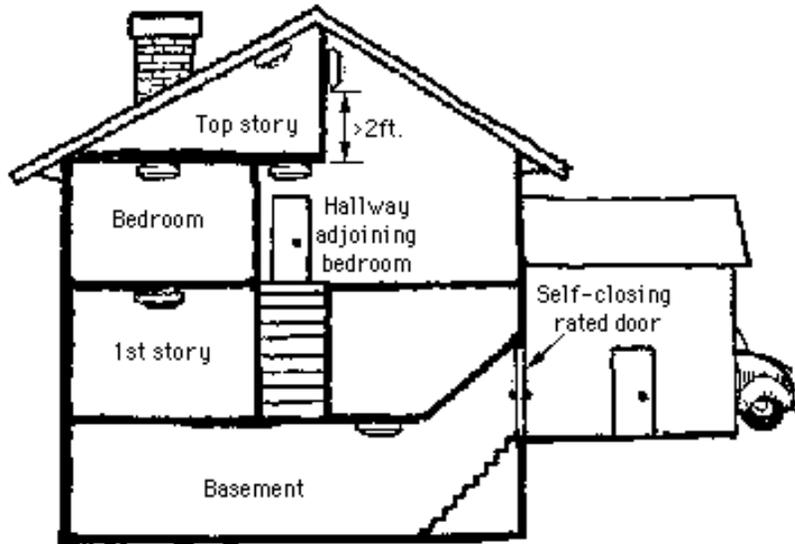

### Protect yourself and your family.

Install smoke alarms - it's the law. The Minnesota Fire Code requires that **every** home have working smoke alarms.



### Smoke alarms save lives.

Most fatal fires occur at night when people are asleep. Often, victims never wake up. A working smoke alarm will detect smoke and sound an alarm to alert you, giving you precious time to escape.



### Buying the best alarm.

There are many types of smoke alarms, each with different features. Alarms can be electrically connected, battery powered or a combination of both. This combination - and a pause feature to reduce nuisance alarms - is highly recommended.



## One smoke alarm is not enough.

Install smoke alarms on every level of your home and near sleeping areas. If you or your loved ones sleep with bedroom doors closed, install an alarm inside each bedroom.




## Where to install smoke alarms.

Because smoke rises, you should place alarms on the ceiling. If you cannot do this, place them high up on a wall according to manufacturer's instructions. **Most importantly, read the installation instructions that come with the alarm.**

There are certain locations to avoid such as near bathrooms, heating appliances, windows, or close to ceiling fans. Don't place smoke alarms in kitchens, bathrooms, furnace rooms, workshops, garages, or in other spaces where temperatures can fall below 32 °F, or exceed 100 °F. These areas are subject to fumes, steam, dust and smoke, which can generate false alarms and contaminate the alarm's alarm. Don't install alarms where air movement can delay the alarm. This means they should be away from windows and at least 3 ft. from warm or cold air ducts or return ducts. Also, don't install them between an air return and a bedroom door.

Don't place alarms where it is inconvenient or unsafe to test them, like in tall foyers or high over a stairway.

If smoke alarms are placed in a room with sloped ceilings, the alarm should be located on the high side of the ceiling. A smoke alarm installed in a stairwell must be so located as to ensure that smoke rising in the stairwell cannot be prevented from reaching the alarm by an intervening door or obstruction. A smoke alarm installed to detect a fire in the basement shall be located in close proximity to the stairway leading to the floor above. Smoke alarms should be mounted on the ceiling at least 4 inches from a wall or on a wall with the top of the alarm not less than 4 inches or more than 12 inches, below the ceiling. Smoke alarms should not be located within 3 feet of supply registers of a forced air

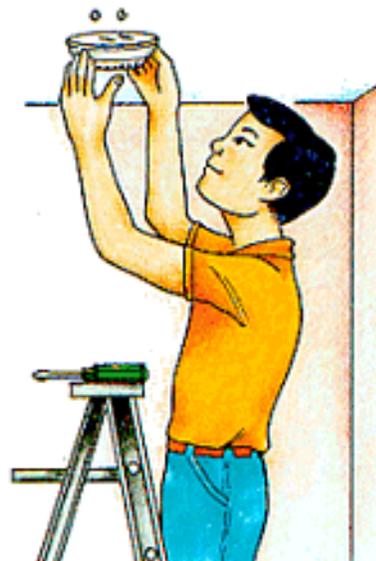

heating or cooling system and doors to a kitchen or bathroom with tub or shower.

### Test your smoke alarm regularly.

Every month, test your smoke alarms using the alarm test button. Once a year, use a smoke test by blowing out a match and letting the smoke roll over the alarm--or you can use that cigar you've been saving.



### Change your clock, change your battery.

Install a new battery of the proper type at least once a year. If the low battery warning beeps, replace the battery immediately. We change our clocks each spring and fall so this is a good time to change your smoke alarm batteries too.



### Gently vacuum alarm every six months.

Dust can clog a smoke alarm, so carefully vacuum the inside of a battery-powered unit using the soft bristle brush. If electrically connected, shut off the power and vacuum the outside vents only. Restore power and test unit when finished.



### Smoke alarms don't last forever.

Smoke alarms do wear out, so if you think your alarms are more than 10 years old, replace them with new ones. Why not replace them with long-life smoke alarms that will eliminate the need for annual battery replacement and the potential hazard of dead batteries for up to 10 years.



### Plan your escape.

Make sure that everyone knows the sound of the smoke alarm and what to do if a fire occurs. Regularly practice your home fire escape plan. Know two ways out of every room and have a pre-arranged meeting place outside. Once out, stay out and call the fire department from a neighbor's home.



