

Appendix J – Self-Evaluation Results – Parking Lot Facilities

A comprehensive overview of all public areas in City of Grand Rapids facilities was performed in 2017. The results of the evaluations are shown in the appendix below.

ADA Transition Plan
 2017 Inspection Summary
 Parking Lots

Parking Lot Name	Parking Stalls			Surface Markings			Signs			Curb Ramps		
	Compliant	Noncompliant	Not Applicable	Compliant	Noncompliant	Not Applicable	Compliant	Noncompliant	Not Applicable	Compliant	Noncompliant	Not Applicable
Block 19 Lot (Pokeg hotel east)		X			X		X					X
Block 37 Lot	X			X			X			X		
Brewed Awakenings	X			X			X				X	
Crystal Lake	X			X			X			X		
Kremer Lot		X			X			X				X
Mall Parking	X				X		X					X
N Ogles Lot		X			X			X				X
North Mall Lot		X			X			X				X
NE Ogles Lot		X		X			X			X		
Old Hospital Lot		X			X			X				X
Professional Building East	X				X			X				X
Professional Lot East	X			X				X				X
West Mall Lot		X			X			X				X

ADA Checklist for Existing Facilities – Parking

City of Grand Rapids ADA Transition Plan


Building: Block 37

Location: Members credit union




Date: 11-1-17

Evaluated By: Jeff wilson



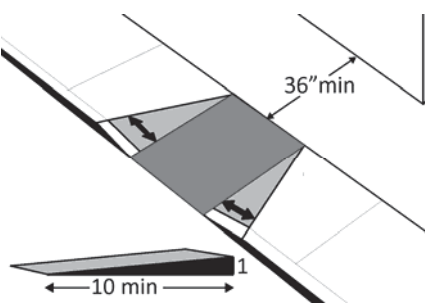
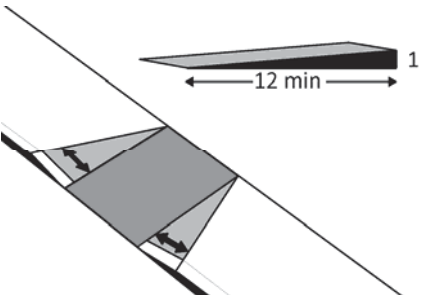
Priority 6 – Parking Lots

<p>6.1 Are an adequate number of accessible spaces provided? [208.2]</p>	<p><input checked="" type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Total #: 48 Accessible #: 2</p>	<table border="1"> <thead> <tr> <th>Total Spaces</th> <th>Accessible Spaces</th> </tr> </thead> <tbody> <tr> <td>1 - 25</td> <td>1</td> </tr> <tr> <td>26 - 50</td> <td>2</td> </tr> <tr> <td>51 - 75</td> <td>3</td> </tr> <tr> <td>76 - 100</td> <td>4</td> </tr> <tr> <td colspan="2">100+ see 2010 Standards 208.2</td> </tr> </tbody> </table>	Total Spaces	Accessible Spaces	1 - 25	1	26 - 50	2	51 - 75	3	76 - 100	4	100+ see 2010 Standards 208.2		
Total Spaces	Accessible Spaces														
1 - 25	1														
26 - 50	2														
51 - 75	3														
76 - 100	4														
100+ see 2010 Standards 208.2															
<p>6.2 Are accessible spaces at least 8 feet wide with an access aisle at least 8 feet wide? [502.2, 502.3]</p> <p>Note: Two spaces may share an access aisle. Check state/local requirements; some specify that each space have its own aisle.</p>	<p><input checked="" type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement: 8'4"</p>														
<p>6.3 Are the access aisles marked with signage and surface painting so as to discourage parking in them? [502.3.3]</p> <p>Note: The marking method and color may be addressed by state/local</p>	<p><input checked="" type="checkbox"/> Yes <input type="checkbox"/> No</p>														

ADA Checklist for Existing Facilities – Parking Lots

	requirements.			
6.4	Is the slope of the accessible parking spaces and access aisles no steeper than 1:48 in all directions? [502.4]	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No Measurement: 3.2		
6.5	Do the access aisles adjoin an accessible route? [502.3]	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA		
6.6	Are accessible spaces identified with a sign that includes the International Symbol of Accessibility? Is the bottom of the sign at least 60 inches and not greater than 66 inches above the ground? [502.6]	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No Measurement: 5'2"		
6.7	Of the total parking spaces, are the accessible spaces located on the closest accessible route to the accessible entrance(s)? [208.3.1]	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No		
Curb Ramps <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No				
6.8	Is the running slope of the curb ramp no steeper than 1:12, i.e. for every inch of height change there are at least 12 inches of curb ramp run? [406.1, 405.2]	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No Measurement: 5.1		

ADA Checklist for Existing Facilities – Parking Lots

<p>6.9 Is the cross slope of the curb ramp, excluding flares, no steeper than 1:48? [406.1, 405.3]</p>	<p><input checked="" type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement: .7</p>		
<p>6.10 Is the curb ramp, excluding flares, at least 36 inches wide? [406.1, 405.5]</p>	<p><input checked="" type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement: 8'</p>		
<p>6.11 At the top of the curb ramp is there a level landing (slope no steeper than 1:48 in all directions) that is at least 36 inches long and at least as wide as the curb ramp? [406.4]</p> <p>If there are curb ramp flares, are the slopes of the flares no steeper than 1:10, i.e. for every inch of height change there are at least 10 inches of flare run? [406.3]</p>	<p><input checked="" type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement: 20'</p> <p><input type="checkbox"/> Yes <input checked="" type="checkbox"/> No</p> <p>Measurement: 10.1</p>		
<p>6.12 If the landing at the top is less than 36 inches long, are there curb ramp flares? [406.4]</p> <p>Are the slopes of the flares no greater than 1:12, i.e. for every inch of height change there are at least 12 inches of flare run? [406.4]</p>	<p><input type="checkbox"/> Yes <input checked="" type="checkbox"/> No</p> <p><input type="checkbox"/> Yes <input checked="" type="checkbox"/> No</p> <p>Measurement: 10.1</p>		

ADA Checklist for Existing Facilities – Parking

City of Grand Rapids ADA Transition Plan


Building: Brewed awaking

Location: West of brewed




Date: 11-01-17

Evaluated By: Jeff wilson



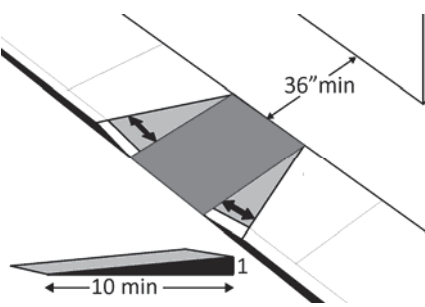
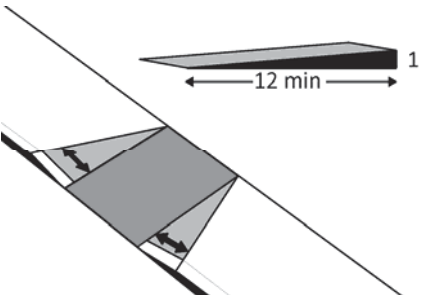
Priority 6 – Parking Lots

<p>6.1 Are an adequate number of accessible spaces provided? [208.2]</p>	<p><input checked="" type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Total #: 17 Accessible #: 1</p>	<table border="1"> <thead> <tr> <th>Total Spaces</th> <th>Accessible Spaces</th> </tr> </thead> <tbody> <tr> <td>1 - 25</td> <td>1</td> </tr> <tr> <td>26 - 50</td> <td>2</td> </tr> <tr> <td>51 - 75</td> <td>3</td> </tr> <tr> <td>76 - 100</td> <td>4</td> </tr> <tr> <td colspan="2">100+ see 2010 Standards 208.2</td> </tr> </tbody> </table>	Total Spaces	Accessible Spaces	1 - 25	1	26 - 50	2	51 - 75	3	76 - 100	4	100+ see 2010 Standards 208.2		
Total Spaces	Accessible Spaces														
1 - 25	1														
26 - 50	2														
51 - 75	3														
76 - 100	4														
100+ see 2010 Standards 208.2															
<p>6.2 Are accessible spaces at least 8 feet wide with an access aisle at least 8 feet wide? [502.2, 502.3]</p> <p>Note: Two spaces may share an access aisle. Check state/local requirements; some specify that each space have its own aisle.</p>	<p><input checked="" type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement: 8'4"</p>														
<p>6.3 Are the access aisles marked with signage and surface painting so as to discourage parking in them? [502.3.3]</p> <p>Note: The marking method and color may be addressed by state/local</p>	<p><input checked="" type="checkbox"/> Yes <input type="checkbox"/> No</p>														

ADA Checklist for Existing Facilities – Parking Lots

	requirements.			
6.4	Is the slope of the accessible parking spaces and access aisles no steeper than 1:48 in all directions? [502.4]	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No Measurement: 2.5		
6.5	Do the access aisles adjoin an accessible route? [502.3]	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA		
6.6	Are accessible spaces identified with a sign that includes the International Symbol of Accessibility? Is the bottom of the sign at least 60 inches and not greater than 66 inches above the ground? [502.6]	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No Measurement:		
6.7	Of the total parking spaces, are the accessible spaces located on the closest accessible route to the accessible entrance(s)? [208.3.1]	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No		
Curb Ramps <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No				
6.8	Is the running slope of the curb ramp no steeper than 1:12, i.e. for every inch of height change there are at least 12 inches of curb ramp run? [406.1, 405.2]	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No Measurement: 8.2		

ADA Checklist for Existing Facilities – Parking Lots

<p>6.9 Is the cross slope of the curb ramp, excluding flares, no steeper than 1:48? [406.1, 405.3]</p>	<p><input checked="" type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement: 2.5</p>		
<p>6.10 Is the curb ramp, excluding flares, at least 36 inches wide? [406.1, 405.5]</p>	<p><input checked="" type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement: 48</p>		
<p>6.11 At the top of the curb ramp is there a level landing (slope no steeper than 1:48 in all directions) that is at least 36 inches long and at least as wide as the curb ramp? [406.4]</p> <p>If there are curb ramp flares, are the slopes of the flares no steeper than 1:10, i.e. for every inch of height change there are at least 10 inches of flare run? [406.3]</p>	<p><input type="checkbox"/> Yes <input checked="" type="checkbox"/> No</p> <p>Measurement: No landing</p> <p><input checked="" type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement: 8.6 & 10</p>		
<p>6.12 If the landing at the top is less than 36 inches long, are there curb ramp flares?</p> <p>Are the slopes of the flares no greater than 1:12, i.e. for every inch of height change there are at least 12 inches of flare run? [406.4]</p>	<p><input checked="" type="checkbox"/> Yes <input type="checkbox"/> No</p> <p><input checked="" type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement: 8.6 & 10</p>		

ADA Checklist for Existing Facilities – Parking

City of Grand Rapids ADA Transition Plan


Building: Mall parking lot

Location: Central square mall




Date: 11-1-17

Evaluated By: Jeff wilson



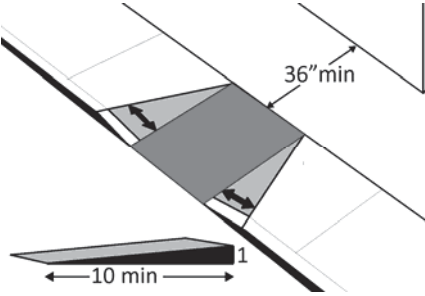
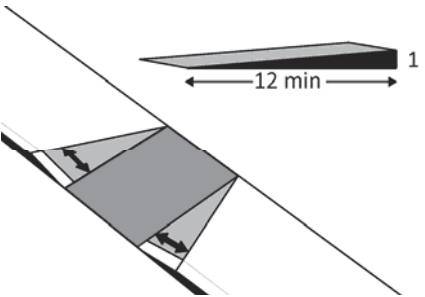
Priority 6 – Parking Lots

<p>6.1 Are an adequate number of accessible spaces provided? [208.2]</p>	<p><input checked="" type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Total #: 122 Accessible #: 5</p>	<table border="1"> <thead> <tr> <th>Total Spaces</th> <th>Accessible Spaces</th> </tr> </thead> <tbody> <tr> <td>1 - 25</td> <td>1</td> </tr> <tr> <td>26 - 50</td> <td>2</td> </tr> <tr> <td>51 - 75</td> <td>3</td> </tr> <tr> <td>76 - 100</td> <td>4</td> </tr> <tr> <td colspan="2">100+ see 2010 Standards 208.2</td> </tr> </tbody> </table>	Total Spaces	Accessible Spaces	1 - 25	1	26 - 50	2	51 - 75	3	76 - 100	4	100+ see 2010 Standards 208.2		
Total Spaces	Accessible Spaces														
1 - 25	1														
26 - 50	2														
51 - 75	3														
76 - 100	4														
100+ see 2010 Standards 208.2															
<p>6.2 Are accessible spaces at least 8 feet wide with an access aisle at least 8 feet wide? [502.2, 502.3]</p> <p>Note: Two spaces may share an access aisle. Check state/local requirements; some specify that each space have its own aisle.</p>	<p><input checked="" type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement: 8'4"</p>														
<p>6.3 Are the access aisles marked with signage and surface painting so as to discourage parking in them? [502.3.3]</p> <p>Note: The marking method and color may be addressed by state/local</p>	<p><input type="checkbox"/> Yes <input checked="" type="checkbox"/> No</p>														

ADA Checklist for Existing Facilities – Parking Lots

	requirements.			
6.4	Is the slope of the accessible parking spaces and access aisles no steeper than 1:48 in all directions? [502.4]	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No Measurement: N A		
6.5	Do the access aisles adjoin an accessible route? [502.3]	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> NA		
6.6	Are accessible spaces identified with a sign that includes the International Symbol of Accessibility? Is the bottom of the sign at least 60 inches and not greater than 66 inches above the ground? [502.6]	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No Measurement: 5'4"		
6.7	Of the total parking spaces, are the accessible spaces located on the closest accessible route to the accessible entrance(s)? [208.3.1]	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No		
Curb Ramps <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No				
6.8	Is the running slope of the curb ramp no steeper than 1:12, i.e. for every inch of height change there are at least 12 inches of curb ramp run? [406.1, 405.2]	<input type="checkbox"/> Yes <input type="checkbox"/> No Measurement:		

ADA Checklist for Existing Facilities – Parking Lots

<p>6.9 Is the cross slope of the curb ramp, excluding flares, no steeper than 1:48? [406.1, 405.3]</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p>		
<p>6.10 Is the curb ramp, excluding flares, at least 36 inches wide? [406.1, 405.5]</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p>		
<p>6.11 At the top of the curb ramp is there a level landing (slope no steeper than 1:48 in all directions) that is at least 36 inches long and at least as wide as the curb ramp? [406.4]</p> <p>If there are curb ramp flares, are the slopes of the flares no steeper than 1:10, i.e. for every inch of height change there are at least 10 inches of flare run? [406.3]</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p> <p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p>		
<p>6.12 If the landing at the top is less than 36 inches long, are there curb ramp flares?</p> <p>Are the slopes of the flares no greater than 1:12, i.e. for every inch of height change there are at least 12 inches of flare run? [406.4]</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p>		

ADA Checklist for Existing Facilities – Parking

City of Grand Rapids ADA Transition Plan


Building: Pokegama parking lot

Location: East of pokegama hotel building




Date: 11-1-17

Evaluated By: Jeff wilson



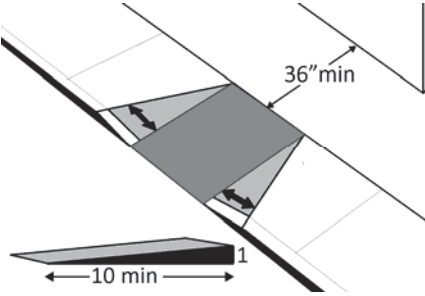
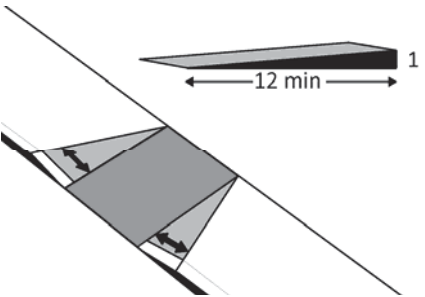
Priority 6 – Parking Lots

<p>6.1 Are an adequate number of accessible spaces provided? [208.2]</p>	<p><input type="checkbox"/> Yes <input checked="" type="checkbox"/> No</p> <p>Total #: 116 Accessible #: 4</p>	<table border="1"> <thead> <tr> <th>Total Spaces</th> <th>Accessible Spaces</th> </tr> </thead> <tbody> <tr> <td>1 - 25</td> <td>1</td> </tr> <tr> <td>26 - 50</td> <td>2</td> </tr> <tr> <td>51 - 75</td> <td>3</td> </tr> <tr> <td>76 - 100</td> <td>4</td> </tr> <tr> <td colspan="2">100+ see 2010 Standards 208.2</td> </tr> </tbody> </table>	Total Spaces	Accessible Spaces	1 - 25	1	26 - 50	2	51 - 75	3	76 - 100	4	100+ see 2010 Standards 208.2		
Total Spaces	Accessible Spaces														
1 - 25	1														
26 - 50	2														
51 - 75	3														
76 - 100	4														
100+ see 2010 Standards 208.2															
<p>6.2 Are accessible spaces at least 8 feet wide with an access aisle at least 8 feet wide? [502.2, 502.3]</p> <p>Note: Two spaces may share an access aisle. Check state/local requirements; some specify that each space have its own aisle.</p>	<p><input checked="" type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement: 8'5"</p>														
<p>6.3 Are the access aisles marked with signage and surface painting so as to discourage parking in them? [502.3.3]</p> <p>Note: The marking method and color may be addressed by state/local</p>	<p><input type="checkbox"/> Yes <input checked="" type="checkbox"/> No</p>														

ADA Checklist for Existing Facilities – Parking Lots

	requirements.			
6.4	Is the slope of the accessible parking spaces and access aisles no steeper than 1:48 in all directions? [502.4]	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No Measurement: 2.1		
6.5	Do the access aisles adjoin an accessible route? [502.3]	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> NA		
6.6	Are accessible spaces identified with a sign that includes the International Symbol of Accessibility? Is the bottom of the sign at least 60 inches and not greater than 66 inches above the ground? [502.6]	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No Measurement: Avg. 5'6"		
6.7	Of the total parking spaces, are the accessible spaces located on the closest accessible route to the accessible entrance(s)? [208.3.1]	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No		
Curb Ramps <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No				
6.8	Is the running slope of the curb ramp no steeper than 1:12, i.e. for every inch of height change there are at least 12 inches of curb ramp run? [406.1, 405.2]	<input type="checkbox"/> Yes <input type="checkbox"/> No Measurement:		

ADA Checklist for Existing Facilities – Parking Lots

<p>6.9 Is the cross slope of the curb ramp, excluding flares, no steeper than 1:48? [406.1, 405.3]</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p>		
<p>6.10 Is the curb ramp, excluding flares, at least 36 inches wide? [406.1, 405.5]</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p>		
<p>6.11 At the top of the curb ramp is there a level landing (slope no steeper than 1:48 in all directions) that is at least 36 inches long and at least as wide as the curb ramp? [406.4]</p> <p>If there are curb ramp flares, are the slopes of the flares no steeper than 1:10, i.e. for every inch of height change there are at least 10 inches of flare run? [406.3]</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p> <p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p>		
<p>6.12 If the landing at the top is less than 36 inches long, are there curb ramp flares?</p> <p>Are the slopes of the flares no greater than 1:12, i.e. for every inch of height change there are at least 12 inches of flare run? [406.4]</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p>		

ADA Checklist for Existing Facilities – Parking

City of Grand Rapids ADA Transition Plan


Building: West mall parking

Location: North of jacks amaco




Date: 11-1-17

Evaluated By: _____



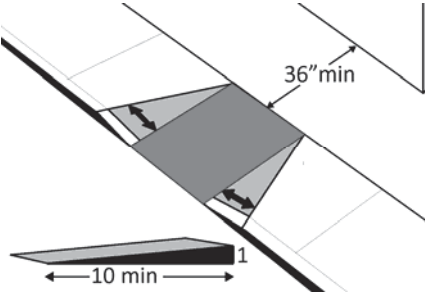
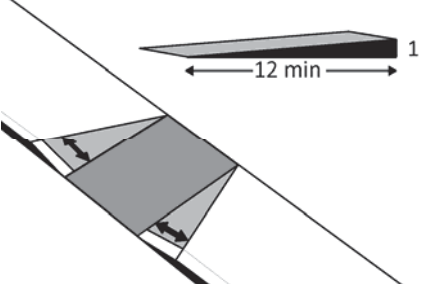
Priority 6 – Parking Lots

<p>6.1 Are an adequate number of accessible spaces provided? [208.2]</p>	<p><input type="checkbox"/> Yes <input checked="" type="checkbox"/> No</p> <p>Total #: 33 Accessible #: 0</p>	<table border="1"> <thead> <tr> <th>Total Spaces</th> <th>Accessible Spaces</th> </tr> </thead> <tbody> <tr> <td>1 - 25</td> <td>1</td> </tr> <tr> <td>26 - 50</td> <td>2</td> </tr> <tr> <td>51 - 75</td> <td>3</td> </tr> <tr> <td>76 - 100</td> <td>4</td> </tr> <tr> <td colspan="2">100+ see 2010 Standards 208.2</td> </tr> </tbody> </table>	Total Spaces	Accessible Spaces	1 - 25	1	26 - 50	2	51 - 75	3	76 - 100	4	100+ see 2010 Standards 208.2		
Total Spaces	Accessible Spaces														
1 - 25	1														
26 - 50	2														
51 - 75	3														
76 - 100	4														
100+ see 2010 Standards 208.2															
<p>6.2 Are accessible spaces at least 8 feet wide with an access aisle at least 8 feet wide? [502.2, 502.3]</p> <p>Note: Two spaces may share an access aisle. Check state/local requirements; some specify that each space have its own aisle.</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p>														
<p>6.3 Are the access aisles marked with signage and surface painting so as to discourage parking in them? [502.3.3]</p> <p>Note: The marking method and color may be addressed by state/local</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p>														

ADA Checklist for Existing Facilities – Parking Lots

	requirements.			
6.4	Is the slope of the accessible parking spaces and access aisles no steeper than 1:48 in all directions? [502.4]	<input type="checkbox"/> Yes <input type="checkbox"/> No Measurement:		
6.5	Do the access aisles adjoin an accessible route? [502.3]	<input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA		
6.6	Are accessible spaces identified with a sign that includes the International Symbol of Accessibility? Is the bottom of the sign at least 60 inches and not greater than 66 inches above the ground? [502.6]	<input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> Yes <input type="checkbox"/> No Measurement:		
6.7	Of the total parking spaces, are the accessible spaces located on the closest accessible route to the accessible entrance(s)? [208.3.1]	<input type="checkbox"/> Yes <input type="checkbox"/> No		
Curb Ramps <input type="checkbox"/> Yes <input type="checkbox"/> No				
6.8	Is the running slope of the curb ramp no steeper than 1:12, i.e. for every inch of height change there are at least 12 inches of curb ramp run? [406.1, 405.2]	<input type="checkbox"/> Yes <input type="checkbox"/> No Measurement:		

ADA Checklist for Existing Facilities – Parking Lots


<p>6.9 Is the cross slope of the curb ramp, excluding flares, no steeper than 1:48? [406.1, 405.3]</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p>		
<p>6.10 Is the curb ramp, excluding flares, at least 36 inches wide? [406.1, 405.5]</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p>		
<p>6.11 At the top of the curb ramp is there a level landing (slope no steeper than 1:48 in all directions) that is at least 36 inches long and at least as wide as the curb ramp? [406.4]</p> <p>If there are curb ramp flares, are the slopes of the flares no steeper than 1:10, i.e. for every inch of height change there are at least 10 inches of flare run? [406.3]</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p> <p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p>		
<p>6.12 If the landing at the top is less than 36 inches long, are there curb ramp flares?</p> <p>Are the slopes of the flares no greater than 1:12, i.e. for every inch of height change there are at least 12 inches of flare run? [406.4]</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p>		

ADA Checklist for Existing Facilities – Parking




City of Grand Rapids ADA Transition Plan

Building: Crystal Lake / Fairgrounds
 Location: Crystal Lk Blvd Roundabout
 Date: 10-25-17
 Evaluated By: Jeff Wilson



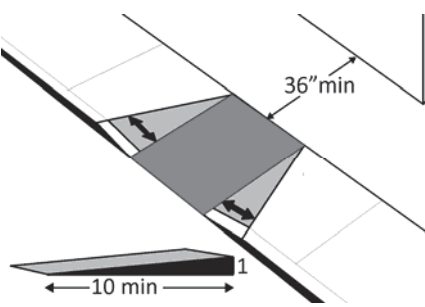
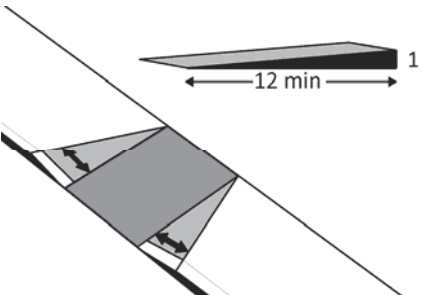
Priority 6 – Parking Lots

<p>6.1 Are an adequate number of accessible spaces provided? [208.2]</p>	<p><input checked="" type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Total #: 9 Accessible #: 1</p>	<table border="1"> <thead> <tr> <th>Total Spaces</th> <th>Accessible Spaces</th> </tr> </thead> <tbody> <tr> <td>1 - 25</td> <td>1</td> </tr> <tr> <td>26 - 50</td> <td>2</td> </tr> <tr> <td>51 - 75</td> <td>3</td> </tr> <tr> <td>76 - 100</td> <td>4</td> </tr> <tr> <td colspan="2">100+ see 2010 Standards 208.2</td> </tr> </tbody> </table>	Total Spaces	Accessible Spaces	1 - 25	1	26 - 50	2	51 - 75	3	76 - 100	4	100+ see 2010 Standards 208.2		
Total Spaces	Accessible Spaces														
1 - 25	1														
26 - 50	2														
51 - 75	3														
76 - 100	4														
100+ see 2010 Standards 208.2															
<p>6.2 Are accessible spaces at least 8 feet wide with an access aisle at least 8 feet wide? [502.2, 502.3]</p> <p>Note: Two spaces may share an access aisle. Check state/local requirements; some specify that each space have its own aisle.</p>	<p><input checked="" type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement: 8'7"</p>														
<p>6.3 Are the access aisles marked with signage and surface painting so as to discourage parking in them? [502.3.3]</p> <p>Note: The marking method and color may be addressed by state/local</p>	<p><input checked="" type="checkbox"/> Yes <input type="checkbox"/> No</p>														

ADA Checklist for Existing Facilities – Parking Lots

	requirements.			
6.4	Is the slope of the accessible parking spaces and access aisles no steeper than 1:48 in all directions? [502.4]	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No Measurement: 2.0% - cross 0.4% - running		
6.5	Do the access aisles adjoin an accessible route? [502.3]	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA		
6.6	Are accessible spaces identified with a sign that includes the International Symbol of Accessibility? Is the bottom of the sign at least 60 inches and not greater than 66 inches above the ground? [502.6]	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No Measurement: 65"		
6.7	Of the total parking spaces, are the accessible spaces located on the closest accessible route to the accessible entrance(s)? [208.3.1]	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No		
Curb Ramps <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No				
6.8	Is the running slope of the curb ramp no steeper than 1:12, i.e. for every inch of height change there are at least 12 inches of curb ramp run? [406.1, 405.2]	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No Measurement: 2.5%		

ADA Checklist for Existing Facilities – Parking Lots

<p>6.9 Is the cross slope of the curb ramp, excluding flares, no steeper than 1:48? [406.1, 405.3]</p>	<p><input checked="" type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement: 0.2%</p>		
<p>6.10 Is the curb ramp, excluding flares, at least 36 inches wide? [406.1, 405.5]</p>	<p><input checked="" type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement: 72"</p>		
<p>6.11 At the top of the curb ramp is there a level landing (slope no steeper than 1:48 in all directions) that is at least 36 inches long and at least as wide as the curb ramp? [406.4]</p> <p>If there are curb ramp flares, are the slopes of the flares no steeper than 1:10, i.e. for every inch of height change there are at least 10 inches of flare run? [406.3]</p>	<p><input checked="" type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement: 72" x 72"</p> <p><input checked="" type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement: 4.5% - 9%</p>		
<p>6.12 If the landing at the top is less than 36 inches long, are there curb ramp flares? Are the slopes of the flares no greater than 1:12, i.e. for every inch of height change there are at least 12 inches of flare run? [406.4]</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement: NA</p>		<p>NA</p>

ADA Checklist for Existing Facilities – Parking

City of Grand Rapids ADA Transition Plan


Building: Kremers

Location: Kremers lot




Date: 11-1-17

Evaluated By: Jeff Wilson



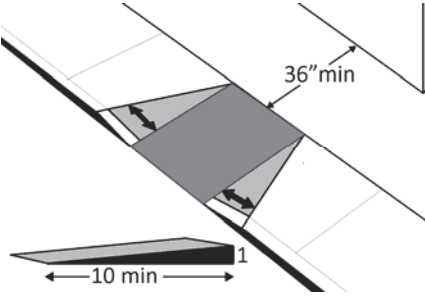
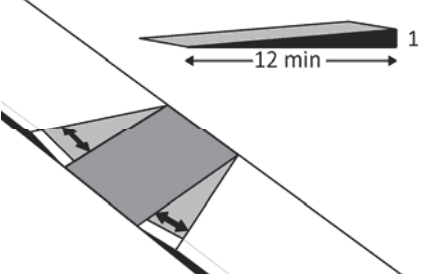
Priority 6 – Parking Lots

<p>6.1 Are an adequate number of accessible spaces provided? [208.2]</p>	<p><input type="checkbox"/> Yes <input checked="" type="checkbox"/> No</p> <p>Total #: 84 Accessible #: 0</p>	<table border="1"> <thead> <tr> <th>Total Spaces</th> <th>Accessible Spaces</th> </tr> </thead> <tbody> <tr> <td>1 - 25</td> <td>1</td> </tr> <tr> <td>26 - 50</td> <td>2</td> </tr> <tr> <td>51 - 75</td> <td>3</td> </tr> <tr> <td>76 - 100</td> <td>4</td> </tr> <tr> <td colspan="2">100+ see 2010 Standards 208.2</td> </tr> </tbody> </table>	Total Spaces	Accessible Spaces	1 - 25	1	26 - 50	2	51 - 75	3	76 - 100	4	100+ see 2010 Standards 208.2		
Total Spaces	Accessible Spaces														
1 - 25	1														
26 - 50	2														
51 - 75	3														
76 - 100	4														
100+ see 2010 Standards 208.2															
<p>6.2 Are accessible spaces at least 8 feet wide with an access aisle at least 8 feet wide? [502.2, 502.3]</p> <p>Note: Two spaces may share an access aisle. Check state/local requirements; some specify that each space have its own aisle.</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p>														
<p>6.3 Are the access aisles marked with signage and surface painting so as to discourage parking in them? [502.3.3]</p> <p>Note: The marking method and color may be addressed by state/local</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p>														

ADA Checklist for Existing Facilities – Parking Lots

	requirements.			
6.4	Is the slope of the accessible parking spaces and access aisles no steeper than 1:48 in all directions? [502.4]	<input type="checkbox"/> Yes <input type="checkbox"/> No Measurement:		
6.5	Do the access aisles adjoin an accessible route? [502.3]	<input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA		
6.6	Are accessible spaces identified with a sign that includes the International Symbol of Accessibility? Is the bottom of the sign at least 60 inches and not greater than 66 inches above the ground? [502.6]	<input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> Yes <input type="checkbox"/> No Measurement:		
6.7	Of the total parking spaces, are the accessible spaces located on the closest accessible route to the accessible entrance(s)? [208.3.1]	<input type="checkbox"/> Yes <input type="checkbox"/> No		
Curb Ramps <input type="checkbox"/> Yes <input type="checkbox"/> No				
6.8	Is the running slope of the curb ramp no steeper than 1:12, i.e. for every inch of height change there are at least 12 inches of curb ramp run? [406.1, 405.2]	<input type="checkbox"/> Yes <input type="checkbox"/> No Measurement:		

ADA Checklist for Existing Facilities – Parking Lots

<p>6.9 Is the cross slope of the curb ramp, excluding flares, no steeper than 1:48? [406.1, 405.3]</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p>		
<p>6.10 Is the curb ramp, excluding flares, at least 36 inches wide? [406.1, 405.5]</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p>		
<p>6.11 At the top of the curb ramp is there a level landing (slope no steeper than 1:48 in all directions) that is at least 36 inches long and at least as wide as the curb ramp? [406.4]</p> <p>If there are curb ramp flares, are the slopes of the flares no steeper than 1:10, i.e. for every inch of height change there are at least 10 inches of flare run? [406.3]</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p> <p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p>		
<p>6.12 If the landing at the top is less than 36 inches long, are there curb ramp flares? [406.4]</p> <p>Are the slopes of the flares no greater than 1:12, i.e. for every inch of height change there are at least 12 inches of flare run? [406.4]</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p>		

ADA Checklist for Existing Facilities – Parking

City of Grand Rapids ADA Transition Plan


Building: NA

Location: NE Ogles / Super One North




Date: 10-25-17

Evaluated By: Jeff Wilson


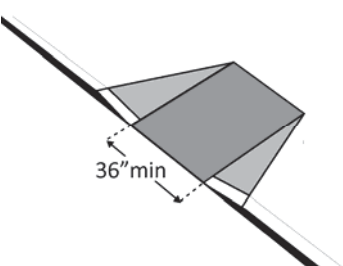
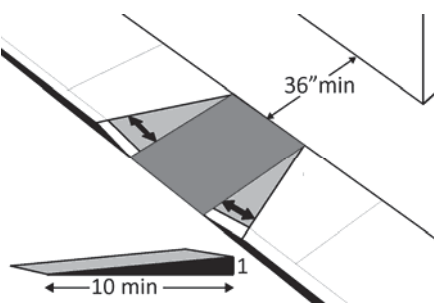
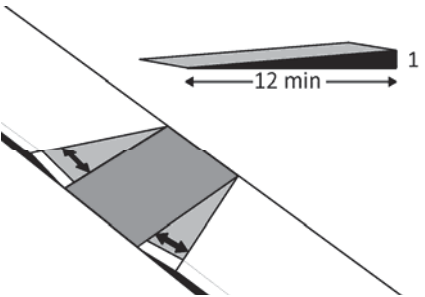
Priority 6 – Parking Lots

<p>6.1 Are an adequate number of accessible spaces provided? [208.2]</p>	<p><input type="checkbox"/> Yes <input checked="" type="checkbox"/> No</p> <p>Total #: 42 Accessible #: 1</p>	<table border="1"> <thead> <tr> <th>Total Spaces</th> <th>Accessible Spaces</th> </tr> </thead> <tbody> <tr> <td>1 - 25</td> <td>1</td> </tr> <tr> <td>26 - 50</td> <td>2</td> </tr> <tr> <td>51 - 75</td> <td>3</td> </tr> <tr> <td>76 - 100</td> <td>4</td> </tr> <tr> <td colspan="2">100+ see 2010 Standards 208.2</td> </tr> </tbody> </table>	Total Spaces	Accessible Spaces	1 - 25	1	26 - 50	2	51 - 75	3	76 - 100	4	100+ see 2010 Standards 208.2		
Total Spaces	Accessible Spaces														
1 - 25	1														
26 - 50	2														
51 - 75	3														
76 - 100	4														
100+ see 2010 Standards 208.2															
<p>6.2 Are accessible spaces at least 8 feet wide with an access aisle at least 8 feet wide? [502.2, 502.3]</p> <p>Note: Two spaces may share an access aisle. Check state/local requirements; some specify that each space have its own aisle.</p>	<p><input checked="" type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement: 25'</p>														
<p>6.3 Are the access aisles marked with signage and surface painting so as to discourage parking in them? [502.3.3]</p> <p>Note: The marking method and color may be addressed by state/local</p>	<p><input checked="" type="checkbox"/> Yes <input type="checkbox"/> No</p>														

ADA Checklist for Existing Facilities – Parking Lots

	requirements.			
6.4	Is the slope of the accessible parking spaces and access aisles no steeper than 1:48 in all directions? [502.4]	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No Measurement: 1.8% - cross 1.1% - running		
6.5	Do the access aisles adjoin an accessible route? [502.3]	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> NA		
6.6	Are accessible spaces identified with a sign that includes the International Symbol of Accessibility? Is the bottom of the sign at least 60 inches and not greater than 66 inches above the ground? [502.6]	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No Measurement:		
6.7	Of the total parking spaces, are the accessible spaces located on the closest accessible route to the accessible entrance(s)? [208.3.1]	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No		
Curb Ramps <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No				
6.8	Is the running slope of the curb ramp no steeper than 1:12, i.e. for every inch of height change there are at least 12 inches of curb ramp run? [406.1, 405.2]	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No Measurement: 3.5%		

ADA Checklist for Existing Facilities – Parking Lots

<p>6.9 Is the cross slope of the curb ramp, excluding flares, no steeper than 1:48? [406.1, 405.3]</p>	<p><input type="checkbox"/> Yes <input checked="" type="checkbox"/> No</p> <p>Measurement: 4.5%</p>		
<p>6.10 Is the curb ramp, excluding flares, at least 36 inches wide? [406.1, 405.5]</p>	<p><input checked="" type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p>		<p>No flares</p>
<p>6.11 At the top of the curb ramp is there a level landing (slope no steeper than 1:48 in all directions) that is at least 36 inches long and at least as wide as the curb ramp? [406.4]</p> <p>If there are curb ramp flares, are the slopes of the flares no steeper than 1:10, i.e. for every inch of height change there are at least 10 inches of flare run? [406.3]</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement: NA</p> <p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement: NA</p>		
<p>6.12 If the landing at the top is less than 36 inches long, are there curb ramp flares?</p> <p>Are the slopes of the flares no greater than 1:12, i.e. for every inch of height change there are at least 12 inches of flare run? [406.4]</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement: NA</p>		<p>NA</p>

ADA Checklist for Existing Facilities – Parking

City of Grand Rapids ADA Transition Plan

Building: North Mall Lot

Location: 5th Street and 3rd Ave NE

Date: 10-25-17

Evaluated By: Jeff Wilson

Priority 6 – Parking Lots

6.1 Are an adequate number of accessible spaces provided?
[208.2]

Yes No

Total #: **22**
Accessible #: **0**

Total Spaces	Accessible Spaces
1 - 25	1
26 - 50	2
51 - 75	3
76 - 100	4
100+ see 2010 Standards 208.2	

6.2 Are accessible spaces at least 8 feet wide with an access aisle at least 8 feet wide?
[502.2, 502.3]

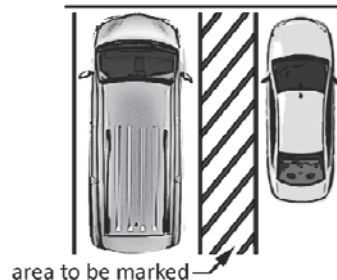
Yes No

Measurement:

Note: Two spaces may share an access aisle. Check state/local requirements; some specify that each space have its own aisle.




6.3 Are the access aisles marked with signage and surface painting so as to discourage parking in them?
[502.3.3]

Yes No



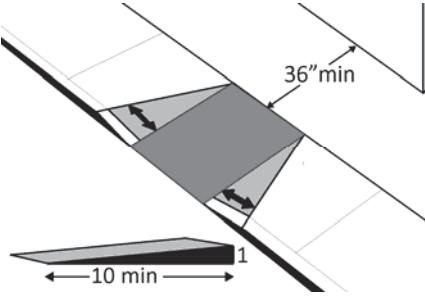
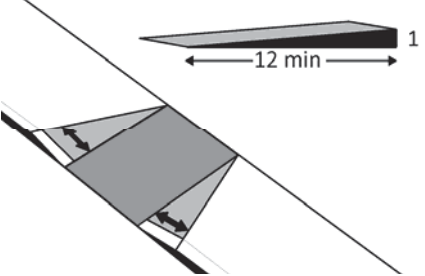


Note: The marking method and color may be addressed by state/local

ADA Checklist for Existing Facilities – Parking Lots

	requirements.			
6.4	Is the slope of the accessible parking spaces and access aisles no steeper than 1:48 in all directions? [502.4]	<input type="checkbox"/> Yes <input type="checkbox"/> No Measurement:		
6.5	Do the access aisles adjoin an accessible route? [502.3]	<input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA		
6.6	Are accessible spaces identified with a sign that includes the International Symbol of Accessibility? Is the bottom of the sign at least 60 inches and not greater than 66 inches above the ground? [502.6]	<input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> Yes <input type="checkbox"/> No Measurement:		
6.7	Of the total parking spaces, are the accessible spaces located on the closest accessible route to the accessible entrance(s)? [208.3.1]	<input type="checkbox"/> Yes <input type="checkbox"/> No		
Curb Ramps <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No				
6.8	Is the running slope of the curb ramp no steeper than 1:12, i.e. for every inch of height change there are at least 12 inches of curb ramp run? [406.1, 405.2]	<input type="checkbox"/> Yes <input type="checkbox"/> No Measurement:		

ADA Checklist for Existing Facilities – Parking Lots

<p>6.9 Is the cross slope of the curb ramp, excluding flares, no steeper than 1:48? [406.1, 405.3]</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p>		
<p>6.10 Is the curb ramp, excluding flares, at least 36 inches wide? [406.1, 405.5]</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p>		
<p>6.11 At the top of the curb ramp is there a level landing (slope no steeper than 1:48 in all directions) that is at least 36 inches long and at least as wide as the curb ramp? [406.4]</p> <p>If there are curb ramp flares, are the slopes of the flares no steeper than 1:10, i.e. for every inch of height change there are at least 10 inches of flare run? [406.3]</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p> <p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p>		
<p>6.12 If the landing at the top is less than 36 inches long, are there curb ramp flares?</p> <p>Are the slopes of the flares no greater than 1:12, i.e. for every inch of height change there are at least 12 inches of flare run? [406.4]</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p>		

ADA Checklist for Existing Facilities – Parking

City of Grand Rapids ADA Transition Plan

Building: North Ogle's Lot

Location: 5th Street and 4th Ave NW

Date: 10-25-17

Evaluated By: Jeff Wilson

Priority 6 – Parking Lots

6.1 Are an adequate number of accessible spaces provided?
[208.2]

Yes No

Total #: 106
Accessible #: 0

Total Spaces	Accessible Spaces
1 - 25	1
26 - 50	2
51 - 75	3
76 - 100	4
100+ see 2010 Standards 208.2	

6.2 Are accessible spaces at least 8 feet wide with an access aisle at least 8 feet wide?
[502.2, 502.3]

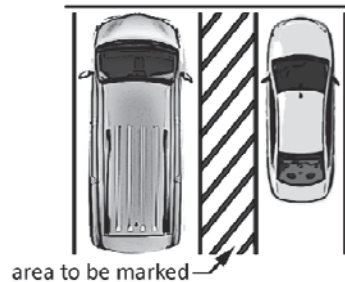
Yes No

Measurement:

Note: Two spaces may share an access aisle. Check state/local requirements; some specify that each space have its own aisle.




6.3 Are the access aisles marked with signage and surface painting so as to discourage parking in them?
[502.3.3]

Yes No



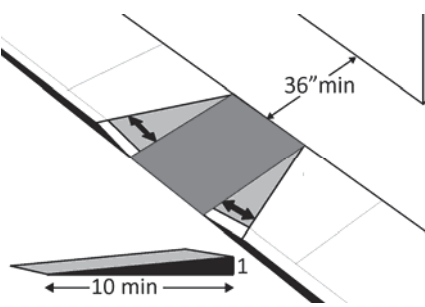
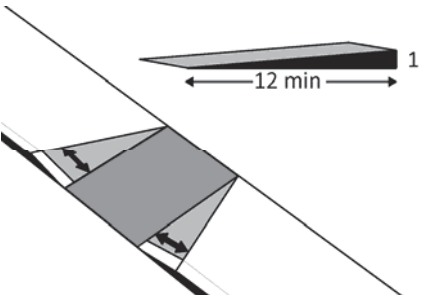


Note: The marking method and color may be addressed by state/local

ADA Checklist for Existing Facilities – Parking Lots

	requirements.			
6.4	Is the slope of the accessible parking spaces and access aisles no steeper than 1:48 in all directions? [502.4]	<input type="checkbox"/> Yes <input type="checkbox"/> No Measurement:		
6.5	Do the access aisles adjoin an accessible route? [502.3]	<input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA		
6.6	Are accessible spaces identified with a sign that includes the International Symbol of Accessibility? Is the bottom of the sign at least 60 inches and not greater than 66 inches above the ground? [502.6]	<input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> Yes <input type="checkbox"/> No Measurement:		
6.7	Of the total parking spaces, are the accessible spaces located on the closest accessible route to the accessible entrance(s)? [208.3.1]	<input type="checkbox"/> Yes <input type="checkbox"/> No		
Curb Ramps <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No				
6.8	Is the running slope of the curb ramp no steeper than 1:12, i.e. for every inch of height change there are at least 12 inches of curb ramp run? [406.1, 405.2]	<input type="checkbox"/> Yes <input type="checkbox"/> No Measurement:		

ADA Checklist for Existing Facilities – Parking Lots

<p>6.9 Is the cross slope of the curb ramp, excluding flares, no steeper than 1:48? [406.1, 405.3]</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p>		
<p>6.10 Is the curb ramp, excluding flares, at least 36 inches wide? [406.1, 405.5]</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p>		
<p>6.11 At the top of the curb ramp is there a level landing (slope no steeper than 1:48 in all directions) that is at least 36 inches long and at least as wide as the curb ramp? [406.4]</p> <p>If there are curb ramp flares, are the slopes of the flares no steeper than 1:10, i.e. for every inch of height change there are at least 10 inches of flare run? [406.3]</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p> <p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p>		
<p>6.12 If the landing at the top is less than 36 inches long, are there curb ramp flares?</p> <p>Are the slopes of the flares no greater than 1:12, i.e. for every inch of height change there are at least 12 inches of flare run? [406.4]</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p>		

ADA Checklist for Existing Facilities – Parking

City of Grand Rapids ADA Transition Plan


Building: Old Hospital

Location: 1st St SE and 2nd Ave SE




Date: 10-25-17

Evaluated By: Jeff Wilson



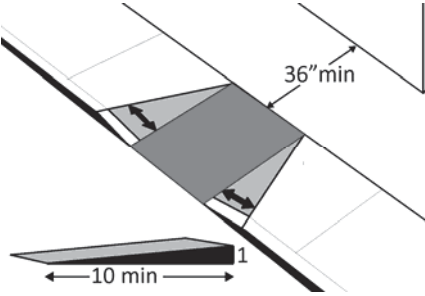
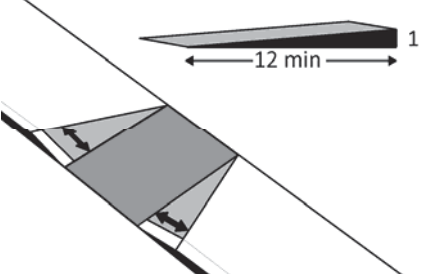
Priority 6 – Parking Lots

<p>6.1 Are an adequate number of accessible spaces provided? [208.2]</p>	<p><input type="checkbox"/> Yes <input checked="" type="checkbox"/> No</p> <p>Total #: 89 Accessible #: 0</p>	<table border="1"> <thead> <tr> <th>Total Spaces</th> <th>Accessible Spaces</th> </tr> </thead> <tbody> <tr> <td>1 - 25</td> <td>1</td> </tr> <tr> <td>26 - 50</td> <td>2</td> </tr> <tr> <td>51 - 75</td> <td>3</td> </tr> <tr> <td>76 - 100</td> <td>4</td> </tr> <tr> <td colspan="2">100+ see 2010 Standards 208.2</td> </tr> </tbody> </table>	Total Spaces	Accessible Spaces	1 - 25	1	26 - 50	2	51 - 75	3	76 - 100	4	100+ see 2010 Standards 208.2		
Total Spaces	Accessible Spaces														
1 - 25	1														
26 - 50	2														
51 - 75	3														
76 - 100	4														
100+ see 2010 Standards 208.2															
<p>6.2 Are accessible spaces at least 8 feet wide with an access aisle at least 8 feet wide? [502.2, 502.3]</p> <p>Note: Two spaces may share an access aisle. Check state/local requirements; some specify that each space have its own aisle.</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p>														
<p>6.3 Are the access aisles marked with signage and surface painting so as to discourage parking in them? [502.3.3]</p> <p>Note: The marking method and color may be addressed by state/local</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p>														

ADA Checklist for Existing Facilities – Parking Lots

	requirements.			
6.4	Is the slope of the accessible parking spaces and access aisles no steeper than 1:48 in all directions? [502.4]	<input type="checkbox"/> Yes <input type="checkbox"/> No Measurement:		
6.5	Do the access aisles adjoin an accessible route? [502.3]	<input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA		
6.6	Are accessible spaces identified with a sign that includes the International Symbol of Accessibility? Is the bottom of the sign at least 60 inches and not greater than 66 inches above the ground? [502.6]	<input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> Yes <input type="checkbox"/> No Measurement:		
6.7	Of the total parking spaces, are the accessible spaces located on the closest accessible route to the accessible entrance(s)? [208.3.1]	<input type="checkbox"/> Yes <input type="checkbox"/> No		
Curb Ramps <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No				
6.8	Is the running slope of the curb ramp no steeper than 1:12, i.e. for every inch of height change there are at least 12 inches of curb ramp run? [406.1, 405.2]	<input type="checkbox"/> Yes <input type="checkbox"/> No Measurement:		

ADA Checklist for Existing Facilities – Parking Lots

<p>6.9 Is the cross slope of the curb ramp, excluding flares, no steeper than 1:48? [406.1, 405.3]</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p>		
<p>6.10 Is the curb ramp, excluding flares, at least 36 inches wide? [406.1, 405.5]</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p>		
<p>6.11 At the top of the curb ramp is there a level landing (slope no steeper than 1:48 in all directions) that is at least 36 inches long and at least as wide as the curb ramp? [406.4]</p> <p>If there are curb ramp flares, are the slopes of the flares no steeper than 1:10, i.e. for every inch of height change there are at least 10 inches of flare run? [406.3]</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p> <p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p>		
<p>6.12 If the landing at the top is less than 36 inches long, are there curb ramp flares?</p> <p>Are the slopes of the flares no greater than 1:12, i.e. for every inch of height change there are at least 12 inches of flare run? [406.4]</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p>		

ADA Checklist for Existing Facilities – Parking

City of Grand Rapids ADA Transition Plan

Building: Professional Building East

Location: NE 1st Ave & NE 6th St

Date: 10-25-17

Evaluated By: Jeff Wilson

Priority 6 – Parking Lots

6.1 Are an adequate number of accessible spaces provided?
[208.2]

Yes No

Total #: 58
Accessible #: 6

Total Spaces	Accessible Spaces
1 - 25	1
26 - 50	2
51 - 75	3
76 - 100	4
100+ see 2010 Standards 208.2	

6.2 Are accessible spaces at least 8 feet wide with an access aisle at least 8 feet wide?
[502.2, 502.3]

Yes No

Measurement:

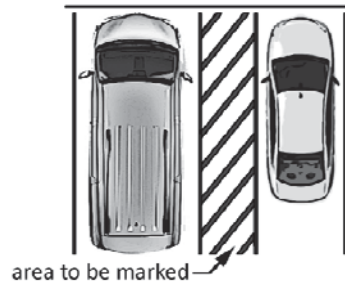
Note: Two spaces may share an access aisle. Check state/local requirements; some specify that each space have its own aisle.

No access aisles
Stalls are 12' wide

6.3 Are the access aisles marked with signage and surface painting so as to discourage parking in them?
[502.3.3]




Yes No

Note: The marking method and color may be addressed by state/local



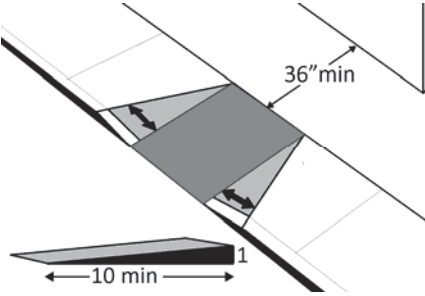
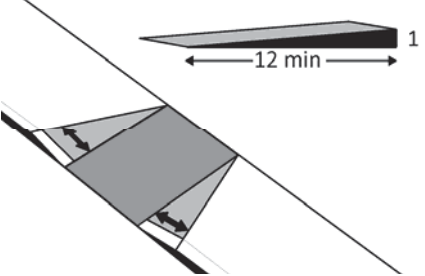


No access aisles

ADA Checklist for Existing Facilities – Parking Lots

	requirements.			
6.4	Is the slope of the accessible parking spaces and access aisles no steeper than 1:48 in all directions? [502.4]	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No Measurement: 1.5% to 1.65%		
6.5	Do the access aisles adjoin an accessible route? [502.3]	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> NA		
6.6	Are accessible spaces identified with a sign that includes the International Symbol of Accessibility? Is the bottom of the sign at least 60 inches and not greater than 66 inches above the ground? [502.6]	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No Measurement: 54" - 80"		2 @ 54" 2 @ 74" 2 @ 80"
6.7	Of the total parking spaces, are the accessible spaces located on the closest accessible route to the accessible entrance(s)? [208.3.1]	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No		
Curb Ramps <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No				
6.8	Is the running slope of the curb ramp no steeper than 1:12, i.e. for every inch of height change there are at least 12 inches of curb ramp run? [406.1, 405.2]	<input type="checkbox"/> Yes <input type="checkbox"/> No Measurement:		

ADA Checklist for Existing Facilities – Parking Lots

<p>6.9 Is the cross slope of the curb ramp, excluding flares, no steeper than 1:48? [406.1, 405.3]</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p>		
<p>6.10 Is the curb ramp, excluding flares, at least 36 inches wide? [406.1, 405.5]</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p>		
<p>6.11 At the top of the curb ramp is there a level landing (slope no steeper than 1:48 in all directions) that is at least 36 inches long and at least as wide as the curb ramp? [406.4]</p> <p>If there are curb ramp flares, are the slopes of the flares no steeper than 1:10, i.e. for every inch of height change there are at least 10 inches of flare run? [406.3]</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p> <p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p>		
<p>6.12 If the landing at the top is less than 36 inches long, are there curb ramp flares? Are the slopes of the flares no greater than 1:12, i.e. for every inch of height change there are at least 12 inches of flare run? [406.4]</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p>		

ADA Checklist for Existing Facilities – Parking

City of Grand Rapids ADA Transition Plan


Building: Professional Lot East

Location: Pokegama & North of 5th St




Date: 10-25-17

Evaluated By: Jeff Wilson



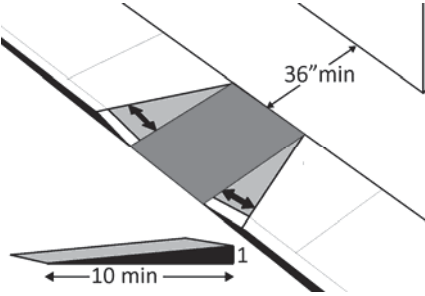
Priority 6 – Parking Lots

<p>6.1 Are an adequate number of accessible spaces provided? [208.2]</p>	<p><input checked="" type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Total #: 14 Accessible #: 1</p>	<table border="1"> <thead> <tr> <th>Total Spaces</th> <th>Accessible Spaces</th> </tr> </thead> <tbody> <tr> <td>1 - 25</td> <td>1</td> </tr> <tr> <td>26 - 50</td> <td>2</td> </tr> <tr> <td>51 - 75</td> <td>3</td> </tr> <tr> <td>76 - 100</td> <td>4</td> </tr> <tr> <td colspan="2">100+ see 2010 Standards 208.2</td> </tr> </tbody> </table>	Total Spaces	Accessible Spaces	1 - 25	1	26 - 50	2	51 - 75	3	76 - 100	4	100+ see 2010 Standards 208.2		
Total Spaces	Accessible Spaces														
1 - 25	1														
26 - 50	2														
51 - 75	3														
76 - 100	4														
100+ see 2010 Standards 208.2															
<p>6.2 Are accessible spaces at least 8 feet wide with an access aisle at least 8 feet wide? [502.2, 502.3]</p> <p>Note: Two spaces may share an access aisle. Check state/local requirements; some specify that each space have its own aisle.</p>	<p><input checked="" type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement: 8'5"</p>														
<p>6.3 Are the access aisles marked with signage and surface painting so as to discourage parking in them? [502.3.3]</p> <p>Note: The marking method and color may be addressed by state/local</p>	<p><input checked="" type="checkbox"/> Yes <input type="checkbox"/> No</p>														

ADA Checklist for Existing Facilities – Parking Lots

	requirements.			
6.4	Is the slope of the accessible parking spaces and access aisles no steeper than 1:48 in all directions? [502.4]	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No Measurement: 1.2% - cross 3.1% - running		
6.5	Do the access aisles adjoin an accessible route? [502.3]	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> NA		
6.6	Are accessible spaces identified with a sign that includes the International Symbol of Accessibility? Is the bottom of the sign at least 60 inches and not greater than 66 inches above the ground? [502.6]	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No Measurement: 4' 5"		
6.7	Of the total parking spaces, are the accessible spaces located on the closest accessible route to the accessible entrance(s)? [208.3.1]	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No		
Curb Ramps <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No				
6.8	Is the running slope of the curb ramp no steeper than 1:12, i.e. for every inch of height change there are at least 12 inches of curb ramp run? [406.1, 405.2]	<input type="checkbox"/> Yes <input type="checkbox"/> No Measurement:		

ADA Checklist for Existing Facilities – Parking Lots

<p>6.9 Is the cross slope of the curb ramp, excluding flares, no steeper than 1:48? [406.1, 405.3]</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p>		
<p>6.10 Is the curb ramp, excluding flares, at least 36 inches wide? [406.1, 405.5]</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p>		
<p>6.11 At the top of the curb ramp is there a level landing (slope no steeper than 1:48 in all directions) that is at least 36 inches long and at least as wide as the curb ramp? [406.4]</p> <p>If there are curb ramp flares, are the slopes of the flares no steeper than 1:10, i.e. for every inch of height change there are at least 10 inches of flare run? [406.3]</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p> <p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p>		
<p>6.12 If the landing at the top is less than 36 inches long, are there curb ramp flares?</p> <p>Are the slopes of the flares no greater than 1:12, i.e. for every inch of height change there are at least 12 inches of flare run? [406.4]</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p>	