

Appendix J – Self-Evaluation Results – Parking Lot Facilities

A comprehensive overview of all public areas in City of Grand Rapids facilities was performed in 2019. The results of the evaluations are shown in the appendix below.

ADA Transition Plan
 2019 Inspection Summary
 Parking Lots

Parking Lot Name	Parking Stalls			Surface Markings			Signs			Curb Ramps		
	Compliant	Noncompliant	Not Applicable	Compliant	Noncompliant	Not Applicable	Compliant	Noncompliant	Not Applicable	Compliant	Noncompliant	Not Applicable
Block 19 Lot (Pokeg hotel east)	X			X				X				X
Block 37 Lot	X			X				X		X		
Brewed Awakenings	X			X			X				X	
Crystal Lake	X			X			X					X
Kremer Lot		X		X			X					X
Mall Parking	X			X				X				X
N Ogles Lot	X			X			X					X
North Mall Lot	X			X			X					X
NE Ogles Lot	X			X			X					X
Old Hospital Lot		X			X			X				X
Professional Building East	X			X				X				X
Professional Lot East	X			X				X				X
West Mall Lot	X			X			X					X

ADA Checklist for Existing Facilities – Parking

City of Grand Rapids ADA Transition Plan

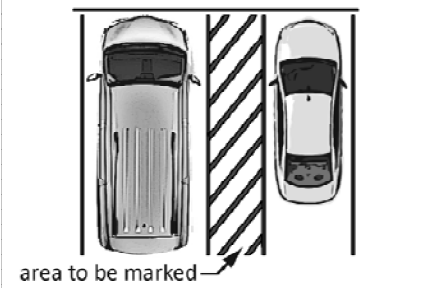
Building: Brewed Awakenings

Location: Block 38


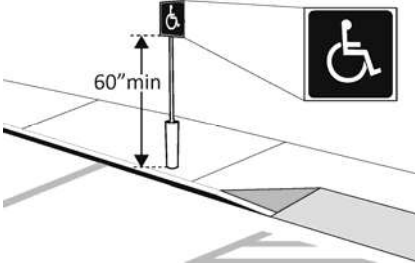
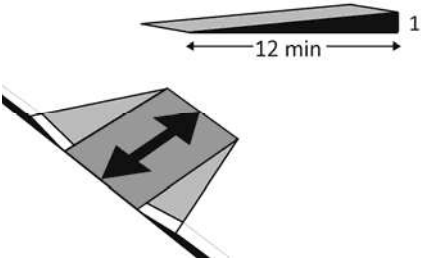
Date: 9/26/19

Evaluated By: Dom DeGuseppi


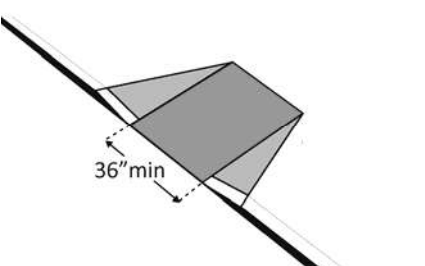
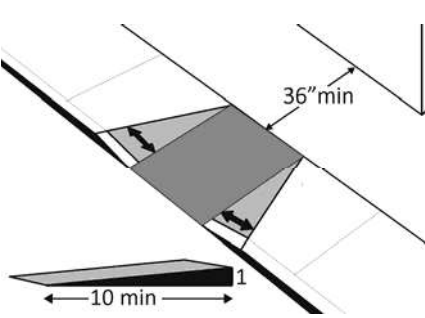

Priority 6 – Parking Lots

<p>6.1 Are an adequate number of accessible spaces provided? [208.2]</p>	<p><input checked="" type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Total #: 17 Accessible #: 1</p>	<table border="1"> <thead> <tr> <th>Total Spaces</th> <th>Accessible Spaces</th> </tr> </thead> <tbody> <tr> <td>1 - 25</td> <td>1</td> </tr> <tr> <td>26 - 50</td> <td>2</td> </tr> <tr> <td>51 - 75</td> <td>3</td> </tr> <tr> <td>76 - 100</td> <td>4</td> </tr> <tr> <td colspan="2">100+ see 2010 Standards 208.2</td> </tr> </tbody> </table>	Total Spaces	Accessible Spaces	1 - 25	1	26 - 50	2	51 - 75	3	76 - 100	4	100+ see 2010 Standards 208.2		
Total Spaces	Accessible Spaces														
1 - 25	1														
26 - 50	2														
51 - 75	3														
76 - 100	4														
100+ see 2010 Standards 208.2															
<p>6.2 Are accessible spaces at least 8 feet wide with an access aisle at least 8 feet wide? [502.2, 502.3]</p> <p>Note: Two spaces may share an access aisle. Check state/local requirements; some specify that each space have its own aisle.</p>	<p><input checked="" type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement: 8'</p>														
<p>6.3 Are the access aisles marked with signage and surface painting so as to discourage parking in them? [502.3.3]</p> <p>Note: The marking method and color may be addressed by state/local</p>	<p><input checked="" type="checkbox"/> Yes <input type="checkbox"/> No</p>														

ADA Checklist for Existing Facilities – Parking Lots

	requirements.			
6.4	Is the slope of the accessible parking spaces and access aisles no steeper than 1:48 in all directions? [502.4]	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No Measurement: .3-1%		
6.5	Do the access aisles adjoin an accessible route? [502.3]	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA		
6.6	Are accessible spaces identified with a sign that includes the International Symbol of Accessibility? Is the bottom of the sign at least 60 inches and not greater than 66 inches above the ground? [502.6]	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No Measurement: 62"		
6.7	Of the total parking spaces, are the accessible spaces located on the closest accessible route to the accessible entrance(s)? [208.3.1]	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No		
Curb Ramps <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No				
6.8	Is the running slope of the curb ramp no steeper than 1:12, i.e. for every inch of height change there are at least 12 inches of curb ramp run? [406.1, 405.2]	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No Measurement: 8.7%		

ADA Checklist for Existing Facilities – Parking Lots

<p>6.9 Is the cross slope of the curb ramp, excluding flares, no steeper than 1:48? [406.1, 405.3]</p>	<p><input type="checkbox"/> Yes <input checked="" type="checkbox"/> No</p> <p>Measurement: 3.5%</p>		
<p>6.10 Is the curb ramp, excluding flares, at least 36 inches wide? [406.1, 405.5]</p>	<p><input checked="" type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement: 48"</p>		
<p>6.11 At the top of the curb ramp is there a level landing (slope no steeper than 1:48 in all directions) that is at least 36 inches long and at least as wide as the curb ramp? [406.4]</p> <p>If there are curb ramp flares, are the slopes of the flares no steeper than 1:10, i.e. for every inch of height change there are at least 10 inches of flare run? [406.3]</p>	<p><input type="checkbox"/> Yes <input checked="" type="checkbox"/> No</p> <p>Measurement:</p> <p><input type="checkbox"/> Yes <input checked="" type="checkbox"/> No</p> <p>Measurement: 8.4%</p>		<p>No landing</p>
<p>6.12 If the landing at the top is less than 36 inches long, are there curb ramp flares?</p> <p>Are the slopes of the flares no greater than 1:12, i.e. for every inch of height change there are at least 12 inches of flare run? [406.4]</p>	<p><input type="checkbox"/> Yes <input checked="" type="checkbox"/> No</p> <p><input type="checkbox"/> Yes <input checked="" type="checkbox"/> No</p> <p>Measurement:</p>		

ADA Checklist for Existing Facilities – Parking

City of Grand Rapids ADA Transition Plan

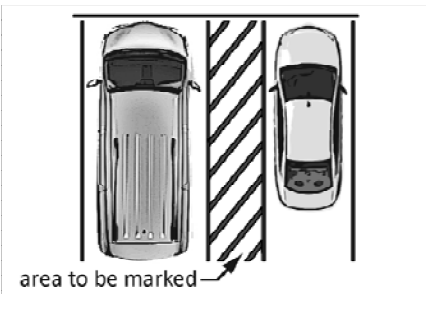
Building: Crystal Lake Lot

Location: _____


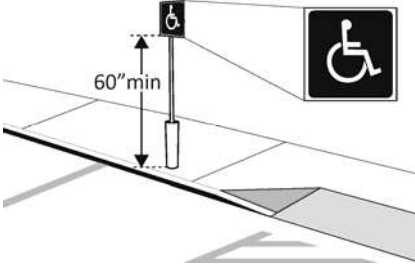
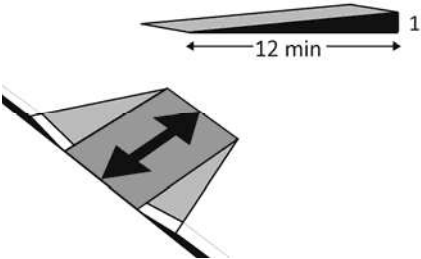
Date: 9/26/19

Evaluated By: Dom DeGuseppi


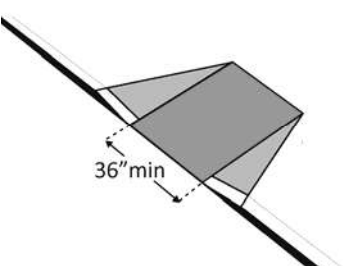
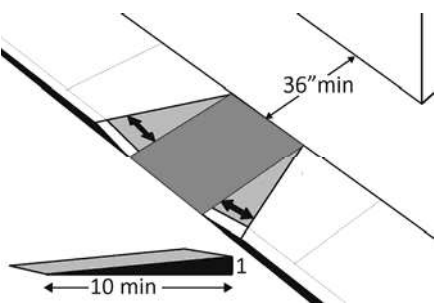

Priority 6 – Parking Lots

<p>6.1 Are an adequate number of accessible spaces provided? [208.2]</p>	<p><input checked="" type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Total #: 9 Accessible #: 1</p>	<table border="1"> <thead> <tr> <th>Total Spaces</th> <th>Accessible Spaces</th> </tr> </thead> <tbody> <tr> <td>1 - 25</td> <td>1</td> </tr> <tr> <td>26 - 50</td> <td>2</td> </tr> <tr> <td>51 - 75</td> <td>3</td> </tr> <tr> <td>76 - 100</td> <td>4</td> </tr> <tr> <td colspan="2">100+ see 2010 Standards 208.2</td> </tr> </tbody> </table>	Total Spaces	Accessible Spaces	1 - 25	1	26 - 50	2	51 - 75	3	76 - 100	4	100+ see 2010 Standards 208.2		
Total Spaces	Accessible Spaces														
1 - 25	1														
26 - 50	2														
51 - 75	3														
76 - 100	4														
100+ see 2010 Standards 208.2															
<p>6.2 Are accessible spaces at least 8 feet wide with an access aisle at least 8 feet wide? [502.2, 502.3]</p> <p>Note: Two spaces may share an access aisle. Check state/local requirements; some specify that each space have its own aisle.</p>	<p><input checked="" type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement: 9'</p>														
<p>6.3 Are the access aisles marked with signage and surface painting so as to discourage parking in them? [502.3.3]</p> <p>Note: The marking method and color may be addressed by state/local</p>	<p><input checked="" type="checkbox"/> Yes <input type="checkbox"/> No</p>														

ADA Checklist for Existing Facilities – Parking Lots

	requirements.			
6.4	Is the slope of the accessible parking spaces and access aisles no steeper than 1:48 in all directions? [502.4]	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No Measurement: 2.5-3%		
6.5	Do the access aisles adjoin an accessible route? [502.3]	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA		
6.6	Are accessible spaces identified with a sign that includes the International Symbol of Accessibility? Is the bottom of the sign at least 60 inches and not greater than 66 inches above the ground? [502.6]	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No Measurement: 66"		
6.7	Of the total parking spaces, are the accessible spaces located on the closest accessible route to the accessible entrance(s)? [208.3.1]	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No		
Curb Ramps <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No				
6.8	Is the running slope of the curb ramp no steeper than 1:12, i.e. for every inch of height change there are at least 12 inches of curb ramp run? [406.1, 405.2]	<input type="checkbox"/> Yes <input type="checkbox"/> No Measurement:		

ADA Checklist for Existing Facilities – Parking Lots

<p>6.9 Is the cross slope of the curb ramp, excluding flares, no steeper than 1:48? [406.1, 405.3]</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p>		
<p>6.10 Is the curb ramp, excluding flares, at least 36 inches wide? [406.1, 405.5]</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p>		
<p>6.11 At the top of the curb ramp is there a level landing (slope no steeper than 1:48 in all directions) that is at least 36 inches long and at least as wide as the curb ramp? [406.4]</p> <p>If there are curb ramp flares, are the slopes of the flares no steeper than 1:10, i.e. for every inch of height change there are at least 10 inches of flare run? [406.3]</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p> <p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p>		
<p>6.12 If the landing at the top is less than 36 inches long, are there curb ramp flares? Are the slopes of the flares no greater than 1:12, i.e. for every inch of height change there are at least 12 inches of flare run? [406.4]</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p>		

ADA Checklist for Existing Facilities – Parking

City of Grand Rapids ADA Transition Plan

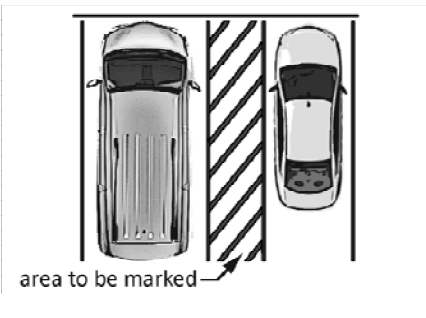
Building: Kremers Lot

Location: Block 37


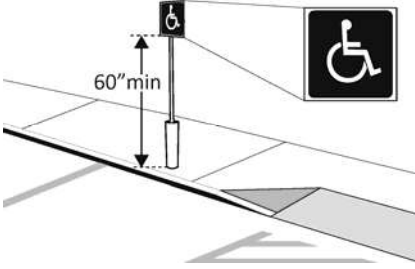
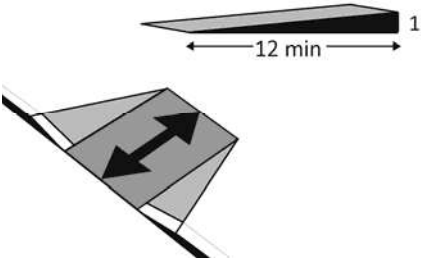
Date: 9/26/19

Evaluated By: Dom DeGuseppi


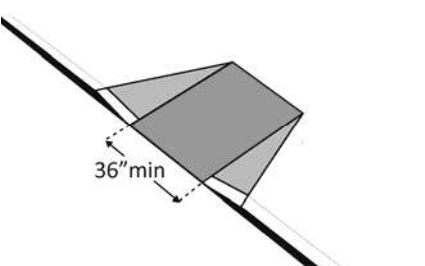
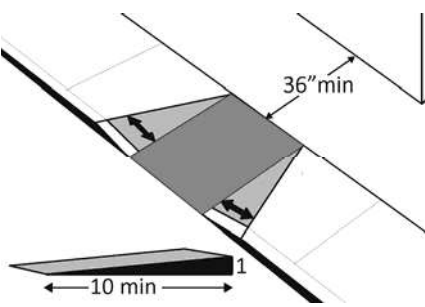

Priority 6 – Parking Lots

<p>6.1 Are an adequate number of accessible spaces provided? [208.2]</p>	<p><input type="checkbox"/> Yes <input checked="" type="checkbox"/> No</p> <p>Total #: 184 Accessible #: 4</p>	<table border="1"> <thead> <tr> <th>Total Spaces</th> <th>Accessible Spaces</th> </tr> </thead> <tbody> <tr> <td>1 - 25</td> <td>1</td> </tr> <tr> <td>26 - 50</td> <td>2</td> </tr> <tr> <td>51 - 75</td> <td>3</td> </tr> <tr> <td>76 - 100</td> <td>4</td> </tr> <tr> <td colspan="2">100+ see 2010 Standards 208.2</td> </tr> </tbody> </table>	Total Spaces	Accessible Spaces	1 - 25	1	26 - 50	2	51 - 75	3	76 - 100	4	100+ see 2010 Standards 208.2		
Total Spaces	Accessible Spaces														
1 - 25	1														
26 - 50	2														
51 - 75	3														
76 - 100	4														
100+ see 2010 Standards 208.2															
<p>6.2 Are accessible spaces at least 8 feet wide with an access aisle at least 8 feet wide? [502.2, 502.3]</p> <p>Note: Two spaces may share an access aisle. Check state/local requirements; some specify that each space have its own aisle.</p>	<p><input checked="" type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement: 9'</p>														
<p>6.3 Are the access aisles marked with signage and surface painting so as to discourage parking in them? [502.3.3]</p> <p>Note: The marking method and color may be addressed by state/local</p>	<p><input checked="" type="checkbox"/> Yes <input type="checkbox"/> No</p>														

ADA Checklist for Existing Facilities – Parking Lots

	requirements.			
6.4	Is the slope of the accessible parking spaces and access aisles no steeper than 1:48 in all directions? [502.4]	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No Measurement: 2%		
6.5	Do the access aisles adjoin an accessible route? [502.3]	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA		
6.6	Are accessible spaces identified with a sign that includes the International Symbol of Accessibility? Is the bottom of the sign at least 60 inches and not greater than 66 inches above the ground? [502.6]	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No Measurement: 60-64"		
6.7	Of the total parking spaces, are the accessible spaces located on the closest accessible route to the accessible entrance(s)? [208.3.1]	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No		
Curb Ramps <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No				
6.8	Is the running slope of the curb ramp no steeper than 1:12, i.e. for every inch of height change there are at least 12 inches of curb ramp run? [406.1, 405.2]	<input type="checkbox"/> Yes <input type="checkbox"/> No Measurement:		

ADA Checklist for Existing Facilities – Parking Lots

<p>6.9 Is the cross slope of the curb ramp, excluding flares, no steeper than 1:48? [406.1, 405.3]</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p>		
<p>6.10 Is the curb ramp, excluding flares, at least 36 inches wide? [406.1, 405.5]</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p>		
<p>6.11 At the top of the curb ramp is there a level landing (slope no steeper than 1:48 in all directions) that is at least 36 inches long and at least as wide as the curb ramp? [406.4]</p> <p>If there are curb ramp flares, are the slopes of the flares no steeper than 1:10, i.e. for every inch of height change there are at least 10 inches of flare run? [406.3]</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p> <p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p>		
<p>6.12 If the landing at the top is less than 36 inches long, are there curb ramp flares?</p> <p>Are the slopes of the flares no greater than 1:12, i.e. for every inch of height change there are at least 12 inches of flare run? [406.4]</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p>		

ADA Checklist for Existing Facilities – Parking

City of Grand Rapids ADA Transition Plan

Building: Mall Parking Lot

Location: Central Square Mall

Date: 9/26/19

Evaluated By: Dom DeGuseppi

Priority 6 – Parking Lots

6.1 Are an adequate number of accessible spaces provided?
[208.2]

Yes No

Total #: **90**
Accessible #: **8**

Total Spaces	Accessible Spaces
1 - 25	1
26 - 50	2
51 - 75	3
76 - 100	4
100+ see 2010 Standards 208.2	

6.2 Are accessible spaces at least 8 feet wide with an access aisle at least 8 feet wide?
[502.2, 502.3]

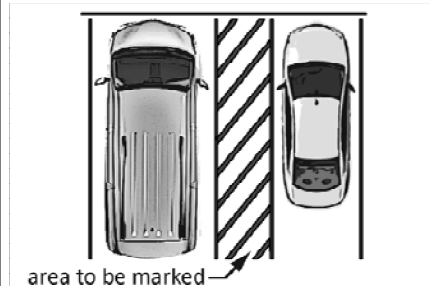
Yes No

Measurement:
9'

Note: Two spaces may share an access aisle. Check state/local requirements; some specify that each space have its own aisle.


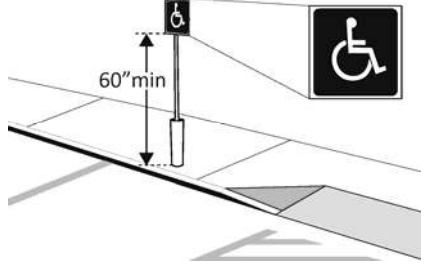
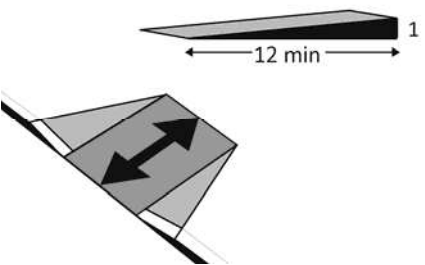
6.3 Are the access aisles marked with signage and surface painting so as to discourage parking in them?
[502.3.3]

Yes No


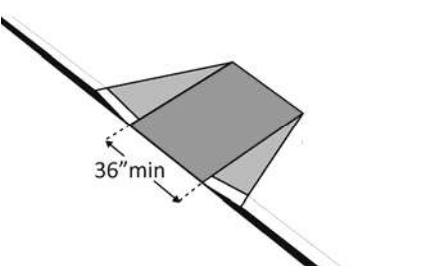
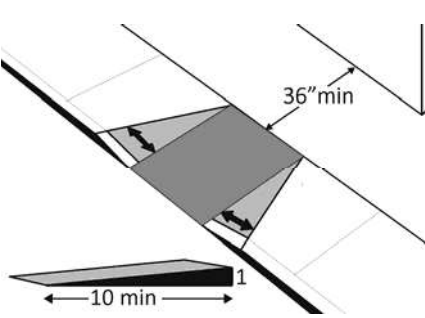



Note: The marking method and color may be addressed by state/local

ADA Checklist for Existing Facilities – Parking Lots

	requirements.			
6.4	Is the slope of the accessible parking spaces and access aisles no steeper than 1:48 in all directions? [502.4]	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No Measurement: 2%		
6.5	Do the access aisles adjoin an accessible route? [502.3]	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> NA		
6.6	Are accessible spaces identified with a sign that includes the International Symbol of Accessibility? Is the bottom of the sign at least 60 inches and not greater than 66 inches above the ground? [502.6]	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No Measurement: 60-68"		Two signs are over 66"
6.7	Of the total parking spaces, are the accessible spaces located on the closest accessible route to the accessible entrance(s)? [208.3.1]	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No		
Curb Ramps <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No				
6.8	Is the running slope of the curb ramp no steeper than 1:12, i.e. for every inch of height change there are at least 12 inches of curb ramp run? [406.1, 405.2]	<input type="checkbox"/> Yes <input type="checkbox"/> No Measurement:		

ADA Checklist for Existing Facilities – Parking Lots

<p>6.9 Is the cross slope of the curb ramp, excluding flares, no steeper than 1:48? [406.1, 405.3]</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p>		
<p>6.10 Is the curb ramp, excluding flares, at least 36 inches wide? [406.1, 405.5]</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p>		
<p>6.11 At the top of the curb ramp is there a level landing (slope no steeper than 1:48 in all directions) that is at least 36 inches long and at least as wide as the curb ramp? [406.4]</p> <p>If there are curb ramp flares, are the slopes of the flares no steeper than 1:10, i.e. for every inch of height change there are at least 10 inches of flare run? [406.3]</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p> <p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p>		
<p>6.12 If the landing at the top is less than 36 inches long, are there curb ramp flares?</p> <p>Are the slopes of the flares no greater than 1:12, i.e. for every inch of height change there are at least 12 inches of flare run? [406.4]</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p>		

ADA Checklist for Existing Facilities – Parking

City of Grand Rapids ADA Transition Plan

Building: Members Credit Union

Location: Block 37

Date: 9/26/19

Evaluated By: Dom DeGuseppi

Priority 6 – Parking Lots

6.1 Are an adequate number of accessible spaces provided?
[208.2]

Yes No

Total #: **48**
Accessible #: **2**

Total Spaces	Accessible Spaces
1 - 25	1
26 - 50	2
51 - 75	3
76 - 100	4
100+ see 2010 Standards 208.2	

6.2 Are accessible spaces at least 8 feet wide with an access aisle at least 8 feet wide?
[502.2, 502.3]

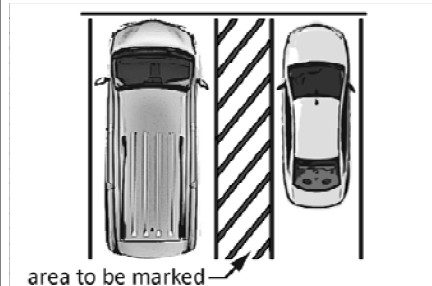
Yes No

Measurement:
8.5'

Note: Two spaces may share an access aisle. Check state/local requirements; some specify that each space have its own aisle.


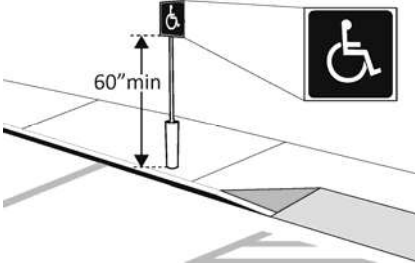
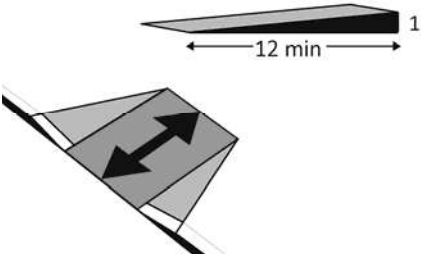
6.3 Are the access aisles marked with signage and surface painting so as to discourage parking in them?
[502.3.3]

Yes No


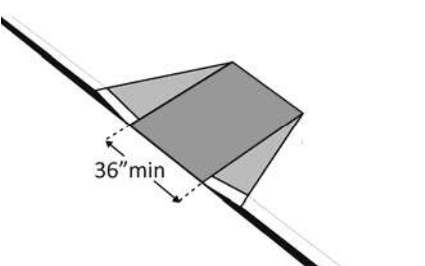
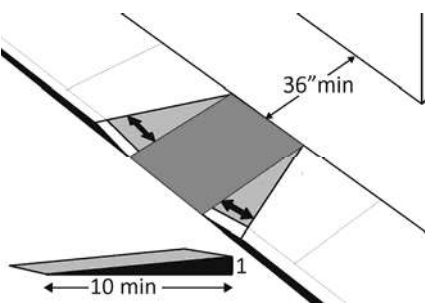



Note: The marking method and color may be addressed by state/local

ADA Checklist for Existing Facilities – Parking Lots

	requirements.			
6.4	Is the slope of the accessible parking spaces and access aisles no steeper than 1:48 in all directions? [502.4]	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No Measurement: 1.8%		
6.5	Do the access aisles adjoin an accessible route? [502.3]	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA		
6.6	Are accessible spaces identified with a sign that includes the International Symbol of Accessibility? Is the bottom of the sign at least 60 inches and not greater than 66 inches above the ground? [502.6]	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No Measurement: 62"		1 sign is on building and height is short
6.7	Of the total parking spaces, are the accessible spaces located on the closest accessible route to the accessible entrance(s)? [208.3.1]	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No		
Curb Ramps <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No				
6.8	Is the running slope of the curb ramp no steeper than 1:12, i.e. for every inch of height change there are at least 12 inches of curb ramp run? [406.1, 405.2]	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No Measurement: 5%		

ADA Checklist for Existing Facilities – Parking Lots

<p>6.9 Is the cross slope of the curb ramp, excluding flares, no steeper than 1:48? [406.1, 405.3]</p>	<p><input checked="" type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement: .2%</p>		
<p>6.10 Is the curb ramp, excluding flares, at least 36 inches wide? [406.1, 405.5]</p>	<p><input checked="" type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement: 96"</p>		
<p>6.11 At the top of the curb ramp is there a level landing (slope no steeper than 1:48 in all directions) that is at least 36 inches long and at least as wide as the curb ramp? [406.4]</p> <p>If there are curb ramp flares, are the slopes of the flares no steeper than 1:10, i.e. for every inch of height change there are at least 10 inches of flare run? [406.3]</p>	<p><input checked="" type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement: 20'</p> <p><input type="checkbox"/> Yes <input checked="" type="checkbox"/> No</p> <p>Measurement: 15%</p>		
<p>6.12 If the landing at the top is less than 36 inches long, are there curb ramp flares? [406.4]</p> <p>Are the slopes of the flares no greater than 1:12, i.e. for every inch of height change there are at least 12 inches of flare run? [406.4]</p>	<p><input type="checkbox"/> Yes <input checked="" type="checkbox"/> No</p> <p><input type="checkbox"/> Yes <input checked="" type="checkbox"/> No</p> <p>Measurement:</p>		<p>No flares on landing</p>

ADA Checklist for Existing Facilities – Parking

City of Grand Rapids ADA Transition Plan

Building: NE Ogles Lot

Location: Block 16

Date: 9/27/19

Evaluated By: Dom DeGuseppi

Priority 6 – Parking Lots

6.1 Are an adequate number of accessible spaces provided?
[208.2]

Yes No

Total #: **42**
Accessible #: **2**

Total Spaces	Accessible Spaces
1 - 25	1
26 - 50	2
51 - 75	3
76 - 100	4
100+ see 2010 Standards 208.2	

6.2 Are accessible spaces at least 8 feet wide with an access aisle at least 8 feet wide?
[502.2, 502.3]

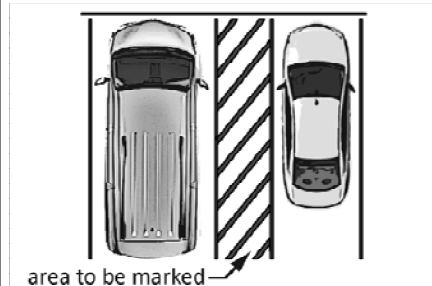
Yes No

Measurement:
8'

Note: Two spaces may share an access aisle. Check state/local requirements; some specify that each space have its own aisle.



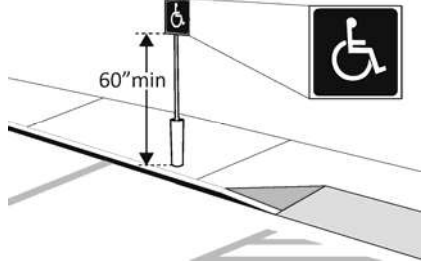
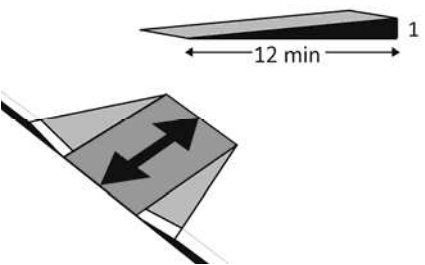
6.3 Are the access aisles marked with signage and surface painting so as to discourage parking in them?
[502.3.3]

Yes No


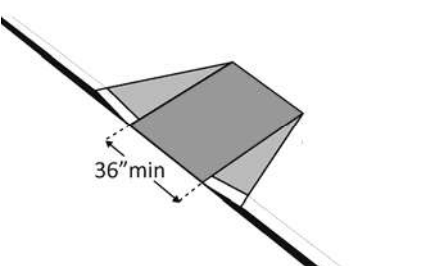
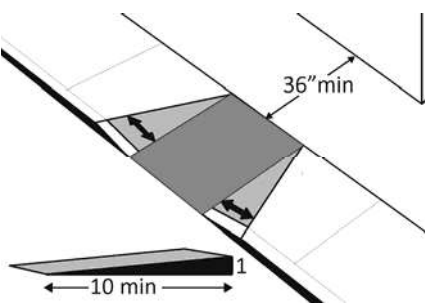



Note: The marking method and color may be addressed by state/local

ADA Checklist for Existing Facilities – Parking Lots

	requirements.			
6.4	Is the slope of the accessible parking spaces and access aisles no steeper than 1:48 in all directions? [502.4]	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No Measurement: 2.5-5%		Cross slopes vary 
6.5	Do the access aisles adjoin an accessible route? [502.3]	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> NA		
6.6	Are accessible spaces identified with a sign that includes the International Symbol of Accessibility? Is the bottom of the sign at least 60 inches and not greater than 66 inches above the ground? [502.6]	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No Measurement: 64"		
6.7	Of the total parking spaces, are the accessible spaces located on the closest accessible route to the accessible entrance(s)? [208.3.1]	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No		
Curb Ramps <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No				
6.8	Is the running slope of the curb ramp no steeper than 1:12, i.e. for every inch of height change there are at least 12 inches of curb ramp run? [406.1, 405.2]	<input type="checkbox"/> Yes <input type="checkbox"/> No Measurement:		

ADA Checklist for Existing Facilities – Parking Lots

<p>6.9 Is the cross slope of the curb ramp, excluding flares, no steeper than 1:48? [406.1, 405.3]</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p>		
<p>6.10 Is the curb ramp, excluding flares, at least 36 inches wide? [406.1, 405.5]</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p>		
<p>6.11 At the top of the curb ramp is there a level landing (slope no steeper than 1:48 in all directions) that is at least 36 inches long and at least as wide as the curb ramp? [406.4]</p> <p>If there are curb ramp flares, are the slopes of the flares no steeper than 1:10, i.e. for every inch of height change there are at least 10 inches of flare run? [406.3]</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p> <p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p>		
<p>6.12 If the landing at the top is less than 36 inches long, are there curb ramp flares? [406.4]</p> <p>Are the slopes of the flares no greater than 1:12, i.e. for every inch of height change there are at least 12 inches of flare run? [406.4]</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p>		

ADA Checklist for Existing Facilities – Parking

City of Grand Rapids ADA Transition Plan

Building: North Mall Lot

Location: Block 13

Date: 9/26/19

Evaluated By: Dom DeGuseppi

Priority 6 – Parking Lots

6.1 Are an adequate number of accessible spaces provided?
[208.2]

Yes No

Total #: **21**
Accessible #: **1**

Total Spaces	Accessible Spaces
1 - 25	1
26 - 50	2
51 - 75	3
76 - 100	4
100+ see 2010 Standards 208.2	

6.2 Are accessible spaces at least 8 feet wide with an access aisle at least 8 feet wide?
[502.2, 502.3]

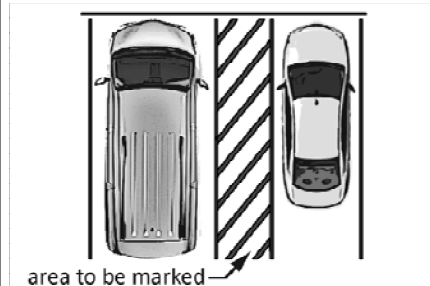
Yes No

Measurement:
8.5'

Note: Two spaces may share an access aisle. Check state/local requirements; some specify that each space have its own aisle.


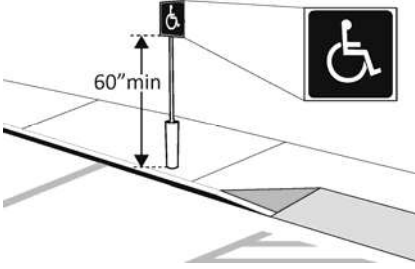
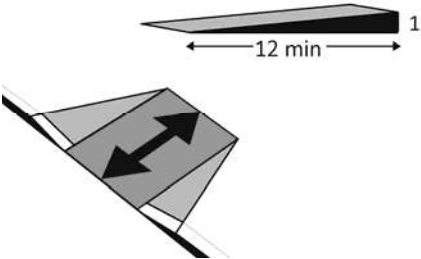
6.3 Are the access aisles marked with signage and surface painting so as to discourage parking in them?
[502.3.3]

Yes No


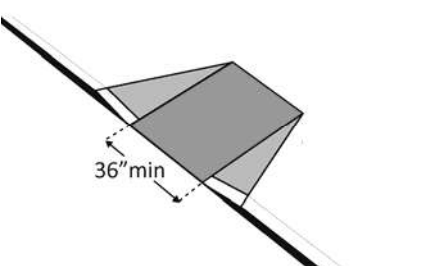
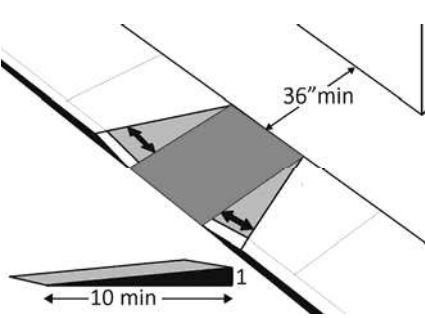



Note: The marking method and color may be addressed by state/local

ADA Checklist for Existing Facilities – Parking Lots

	requirements.		
6.4	Is the slope of the accessible parking spaces and access aisles no steeper than 1:48 in all directions? [502.4]	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No Measurement: 1.8% - 3.2%	
6.5	Do the access aisles adjoin an accessible route? [502.3]	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> NA	
6.6	Are accessible spaces identified with a sign that includes the International Symbol of Accessibility? Is the bottom of the sign at least 60 inches and not greater than 66 inches above the ground? [502.6]	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No Measurement: 64"	
6.7	Of the total parking spaces, are the accessible spaces located on the closest accessible route to the accessible entrance(s)? [208.3.1]	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	
Curb Ramps <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No			
6.8	Is the running slope of the curb ramp no steeper than 1:12, i.e. for every inch of height change there are at least 12 inches of curb ramp run? [406.1, 405.2]	<input type="checkbox"/> Yes <input type="checkbox"/> No Measurement:	

ADA Checklist for Existing Facilities – Parking Lots

<p>6.9 Is the cross slope of the curb ramp, excluding flares, no steeper than 1:48? [406.1, 405.3]</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p>		
<p>6.10 Is the curb ramp, excluding flares, at least 36 inches wide? [406.1, 405.5]</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p>		
<p>6.11 At the top of the curb ramp is there a level landing (slope no steeper than 1:48 in all directions) that is at least 36 inches long and at least as wide as the curb ramp? [406.4]</p> <p>If there are curb ramp flares, are the slopes of the flares no steeper than 1:10, i.e. for every inch of height change there are at least 10 inches of flare run? [406.3]</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p> <p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p>		
<p>6.12 If the landing at the top is less than 36 inches long, are there curb ramp flares?</p> <p>Are the slopes of the flares no greater than 1:12, i.e. for every inch of height change there are at least 12 inches of flare run? [406.4]</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p>		

ADA Checklist for Existing Facilities – Parking

City of Grand Rapids ADA Transition Plan

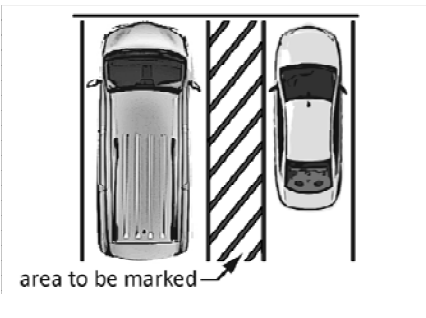
Building: North Ogles Lot

Location: Block 15


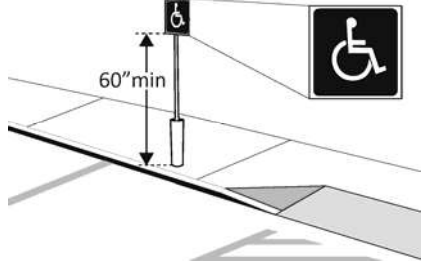
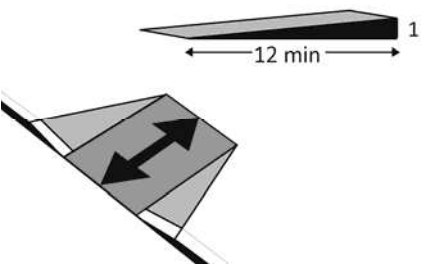
Date: 9/27/19

Evaluated By: Dom DeGuseppi


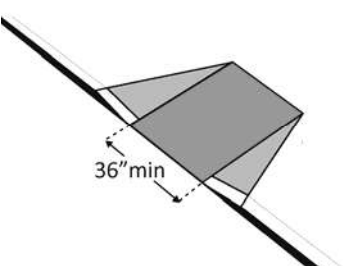
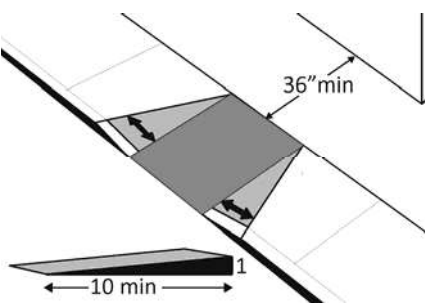

Priority 6 – Parking Lots

<p>6.1 Are an adequate number of accessible spaces provided? [208.2]</p>	<p><input checked="" type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Total #: 82 Accessible #: 5</p>	<table border="1"> <thead> <tr> <th>Total Spaces</th> <th>Accessible Spaces</th> </tr> </thead> <tbody> <tr> <td>1 - 25</td> <td>1</td> </tr> <tr> <td>26 - 50</td> <td>2</td> </tr> <tr> <td>51 - 75</td> <td>3</td> </tr> <tr> <td>76 - 100</td> <td>4</td> </tr> <tr> <td colspan="2">100+ see 2010 Standards 208.2</td> </tr> </tbody> </table>	Total Spaces	Accessible Spaces	1 - 25	1	26 - 50	2	51 - 75	3	76 - 100	4	100+ see 2010 Standards 208.2		
Total Spaces	Accessible Spaces														
1 - 25	1														
26 - 50	2														
51 - 75	3														
76 - 100	4														
100+ see 2010 Standards 208.2															
<p>6.2 Are accessible spaces at least 8 feet wide with an access aisle at least 8 feet wide? [502.2, 502.3]</p> <p>Note: Two spaces may share an access aisle. Check state/local requirements; some specify that each space have its own aisle.</p>	<p><input checked="" type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement: 8'-9'</p>		<p>Spaces varied between 8' and 9'</p>												
<p>6.3 Are the access aisles marked with signage and surface painting so as to discourage parking in them? [502.3.3]</p> <p>Note: The marking method and color may be addressed by state/local</p>	<p><input checked="" type="checkbox"/> Yes <input type="checkbox"/> No</p>														

ADA Checklist for Existing Facilities – Parking Lots

	requirements.			
6.4	Is the slope of the accessible parking spaces and access aisles no steeper than 1:48 in all directions? [502.4]	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No Measurement: 1.5-3.1%		Slopes vary
6.5	Do the access aisles adjoin an accessible route? [502.3]	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input checked="" type="checkbox"/> NA		
6.6	Are accessible spaces identified with a sign that includes the International Symbol of Accessibility? Is the bottom of the sign at least 60 inches and not greater than 66 inches above the ground? [502.6]	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No Measurement: 62-65"		
6.7	Of the total parking spaces, are the accessible spaces located on the closest accessible route to the accessible entrance(s)? [208.3.1]	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No		
Curb Ramps <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No				
6.8	Is the running slope of the curb ramp no steeper than 1:12, i.e. for every inch of height change there are at least 12 inches of curb ramp run? [406.1, 405.2]	<input type="checkbox"/> Yes <input type="checkbox"/> No Measurement:		

ADA Checklist for Existing Facilities – Parking Lots

<p>6.9 Is the cross slope of the curb ramp, excluding flares, no steeper than 1:48? [406.1, 405.3]</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p>		
<p>6.10 Is the curb ramp, excluding flares, at least 36 inches wide? [406.1, 405.5]</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p>		
<p>6.11 At the top of the curb ramp is there a level landing (slope no steeper than 1:48 in all directions) that is at least 36 inches long and at least as wide as the curb ramp? [406.4]</p> <p>If there are curb ramp flares, are the slopes of the flares no steeper than 1:10, i.e. for every inch of height change there are at least 10 inches of flare run? [406.3]</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p> <p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p>		
<p>6.12 If the landing at the top is less than 36 inches long, are there curb ramp flares? [406.4]</p> <p>Are the slopes of the flares no greater than 1:12, i.e. for every inch of height change there are at least 12 inches of flare run? [406.4]</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p>		

ADA Checklist for Existing Facilities – Parking

City of Grand Rapids ADA Transition Plan

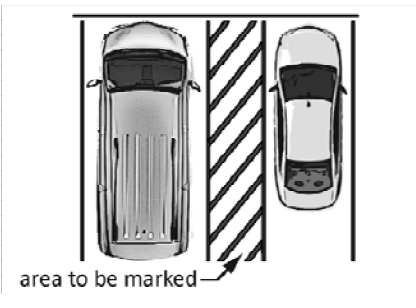
Building: Old Hospital

Location: Block 54


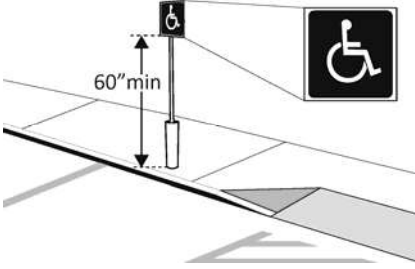
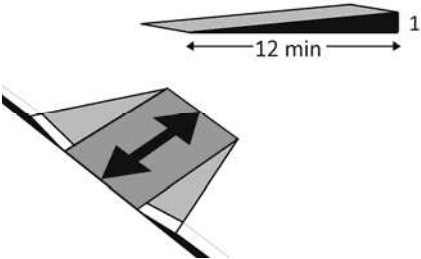
Date: 9/26/19

Evaluated By: Dom DeGuseppi


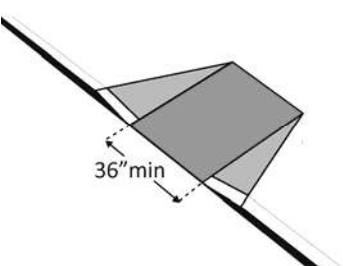
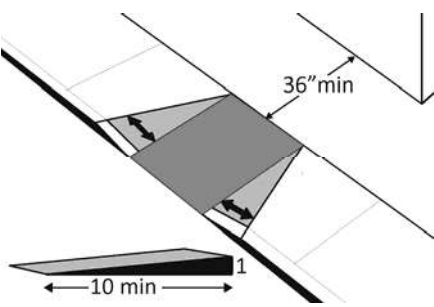

Priority 6 – Parking Lots

<p>6.1 Are an adequate number of accessible spaces provided? [208.2]</p>	<p><input type="checkbox"/> Yes <input checked="" type="checkbox"/> No</p> <p>Total #: 136 Accessible #: 0</p>	<table border="1"> <thead> <tr> <th>Total Spaces</th> <th>Accessible Spaces</th> </tr> </thead> <tbody> <tr> <td>1 - 25</td> <td>1</td> </tr> <tr> <td>26 - 50</td> <td>2</td> </tr> <tr> <td>51 - 75</td> <td>3</td> </tr> <tr> <td>76 - 100</td> <td>4</td> </tr> <tr> <td colspan="2">100+ see 2010 Standards 208.2</td> </tr> </tbody> </table>	Total Spaces	Accessible Spaces	1 - 25	1	26 - 50	2	51 - 75	3	76 - 100	4	100+ see 2010 Standards 208.2		<p>2 stalls marked by sign with no paint or aisles</p>
Total Spaces	Accessible Spaces														
1 - 25	1														
26 - 50	2														
51 - 75	3														
76 - 100	4														
100+ see 2010 Standards 208.2															
<p>6.2 Are accessible spaces at least 8 feet wide with an access aisle at least 8 feet wide? [502.2, 502.3]</p> <p>Note: Two spaces may share an access aisle. Check state/local requirements; some specify that each space have its own aisle.</p>	<p><input type="checkbox"/> Yes <input checked="" type="checkbox"/> No</p> <p>Measurement: 9'</p>		<p>Spaces are 9' feet wide but do not have aisles</p>												
<p>6.3 Are the access aisles marked with signage and surface painting so as to discourage parking in them? [502.3.3]</p> <p>Note: The marking method and color may be addressed by state/local</p>	<p><input type="checkbox"/> Yes <input checked="" type="checkbox"/> No</p>														

ADA Checklist for Existing Facilities – Parking Lots

	requirements.			
6.4	Is the slope of the accessible parking spaces and access aisles no steeper than 1:48 in all directions? [502.4]	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No Measurement: 1.2%		
6.5	Do the access aisles adjoin an accessible route? [502.3]	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> NA		
6.6	Are accessible spaces identified with a sign that includes the International Symbol of Accessibility? Is the bottom of the sign at least 60 inches and not greater than 66 inches above the ground? [502.6]	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No Measurement: 55"		
6.7	Of the total parking spaces, are the accessible spaces located on the closest accessible route to the accessible entrance(s)? [208.3.1]	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No		
Curb Ramps <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No				
6.8	Is the running slope of the curb ramp no steeper than 1:12, i.e. for every inch of height change there are at least 12 inches of curb ramp run? [406.1, 405.2]	<input type="checkbox"/> Yes <input type="checkbox"/> No Measurement:		

ADA Checklist for Existing Facilities – Parking Lots

<p>6.9 Is the cross slope of the curb ramp, excluding flares, no steeper than 1:48? [406.1, 405.3]</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p>		
<p>6.10 Is the curb ramp, excluding flares, at least 36 inches wide? [406.1, 405.5]</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p>		
<p>6.11 At the top of the curb ramp is there a level landing (slope no steeper than 1:48 in all directions) that is at least 36 inches long and at least as wide as the curb ramp? [406.4]</p> <p>If there are curb ramp flares, are the slopes of the flares no steeper than 1:10, i.e. for every inch of height change there are at least 10 inches of flare run? [406.3]</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p> <p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p>		
<p>6.12 If the landing at the top is less than 36 inches long, are there curb ramp flares?</p> <p>Are the slopes of the flares no greater than 1:12, i.e. for every inch of height change there are at least 12 inches of flare run? [406.4]</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p>		

ADA Checklist for Existing Facilities – Parking

City of Grand Rapids ADA Transition Plan

Building: Pokegama Hotel Lot

Location: Block 19

Date: 9/26/19

Evaluated By: Dom DeGuseppi

Priority 6 – Parking Lots

6.1 Are an adequate number of accessible spaces provided?
[208.2]

Yes No

Total #: **111**
Accessible #: **6**

Total Spaces	Accessible Spaces
1 - 25	1
26 - 50	2
51 - 75	3
76 - 100	4
100+ see 2010 Standards 208.2	

6.2 Are accessible spaces at least 8 feet wide with an access aisle at least 8 feet wide?
[502.2, 502.3]

Yes No

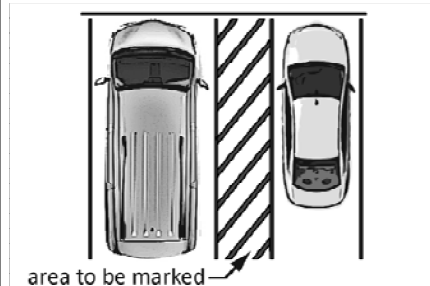
Measurement:
8.5-10'

Space sizes varied

Note: Two spaces may share an access aisle. Check state/local requirements; some specify that each space have its own aisle.


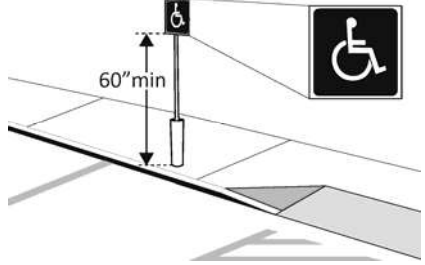

6.3 Are the access aisles marked with signage and surface painting so as to discourage parking in them?
[502.3.3]

Yes No


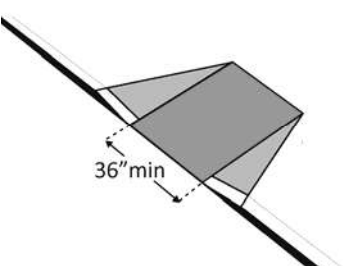
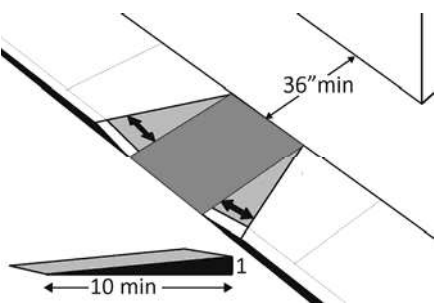



Note: The marking method and color may be addressed by state/local

ADA Checklist for Existing Facilities – Parking Lots

	requirements.			
6.4	Is the slope of the accessible parking spaces and access aisles no steeper than 1:48 in all directions? [502.4]	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No Measurement:		
6.5	Do the access aisles adjoin an accessible route? [502.3]	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> NA		
6.6	Are accessible spaces identified with a sign that includes the International Symbol of Accessibility? Is the bottom of the sign at least 60 inches and not greater than 66 inches above the ground? [502.6]	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No Measurement: 58-84"		1 sign is 84" 2 signs are 58"
6.7	Of the total parking spaces, are the accessible spaces located on the closest accessible route to the accessible entrance(s)? [208.3.1]	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No		
Curb Ramps <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No				
6.8	Is the running slope of the curb ramp no steeper than 1:12, i.e. for every inch of height change there are at least 12 inches of curb ramp run? [406.1, 405.2]	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No Measurement:		

ADA Checklist for Existing Facilities – Parking Lots

<p>6.9 Is the cross slope of the curb ramp, excluding flares, no steeper than 1:48? [406.1, 405.3]</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p>		
<p>6.10 Is the curb ramp, excluding flares, at least 36 inches wide? [406.1, 405.5]</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p>		
<p>6.11 At the top of the curb ramp is there a level landing (slope no steeper than 1:48 in all directions) that is at least 36 inches long and at least as wide as the curb ramp? [406.4]</p> <p>If there are curb ramp flares, are the slopes of the flares no steeper than 1:10, i.e. for every inch of height change there are at least 10 inches of flare run? [406.3]</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p> <p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p>		
<p>6.12 If the landing at the top is less than 36 inches long, are there curb ramp flares? [406.4]</p> <p>Are the slopes of the flares no greater than 1:12, i.e. for every inch of height change there are at least 12 inches of flare run? [406.4]</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p>		

ADA Checklist for Existing Facilities – Parking

City of Grand Rapids ADA Transition Plan

Building: Prof Lot East

Location: Block 16

Date: 9/27/19

Evaluated By: Dom DeGuseppi

Priority 6 – Parking Lots

6.1 Are an adequate number of accessible spaces provided?
[208.2]

Yes No

Total #: **14**
Accessible #: **1**

Total Spaces	Accessible Spaces
1 - 25	1
26 - 50	2
51 - 75	3
76 - 100	4
100+ see 2010 Standards 208.2	

6.2 Are accessible spaces at least 8 feet wide with an access aisle at least 8 feet wide?
[502.2, 502.3]

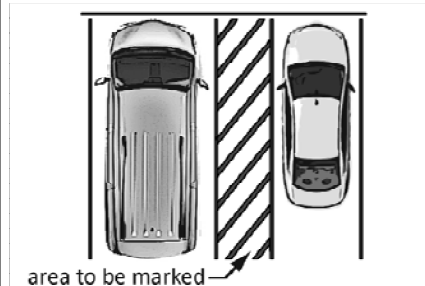
Yes No

Measurement:
8.5'

Note: Two spaces may share an access aisle. Check state/local requirements; some specify that each space have its own aisle.


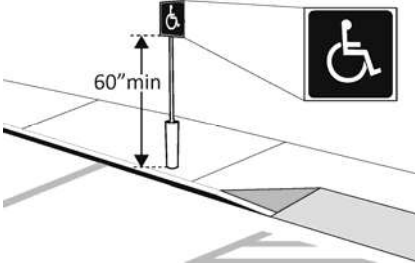
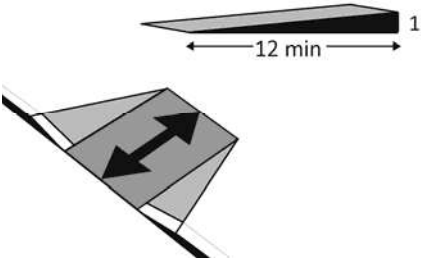
6.3 Are the access aisles marked with signage and surface painting so as to discourage parking in them?
[502.3.3]

Yes No


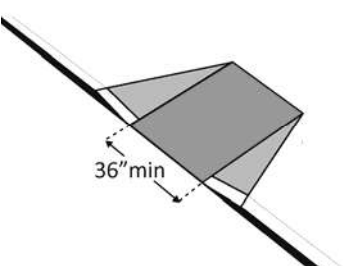
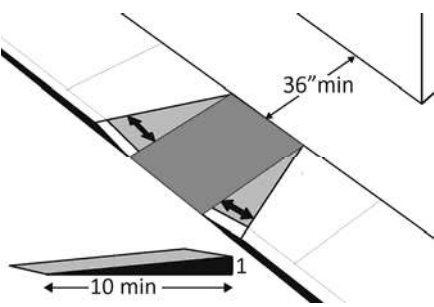



Note: The marking method and color may be addressed by state/local

ADA Checklist for Existing Facilities – Parking Lots

	requirements.			
6.4	Is the slope of the accessible parking spaces and access aisles no steeper than 1:48 in all directions? [502.4]	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No Measurement: 2.3%		
6.5	Do the access aisles adjoin an accessible route? [502.3]	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> NA		
6.6	Are accessible spaces identified with a sign that includes the International Symbol of Accessibility? Is the bottom of the sign at least 60 inches and not greater than 66 inches above the ground? [502.6]	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No Measurement: 54"		
6.7	Of the total parking spaces, are the accessible spaces located on the closest accessible route to the accessible entrance(s)? [208.3.1]	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No		
Curb Ramps <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No				
6.8	Is the running slope of the curb ramp no steeper than 1:12, i.e. for every inch of height change there are at least 12 inches of curb ramp run? [406.1, 405.2]	<input type="checkbox"/> Yes <input type="checkbox"/> No Measurement:		

ADA Checklist for Existing Facilities – Parking Lots

<p>6.9 Is the cross slope of the curb ramp, excluding flares, no steeper than 1:48? [406.1, 405.3]</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p>		
<p>6.10 Is the curb ramp, excluding flares, at least 36 inches wide? [406.1, 405.5]</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p>		
<p>6.11 At the top of the curb ramp is there a level landing (slope no steeper than 1:48 in all directions) that is at least 36 inches long and at least as wide as the curb ramp? [406.4]</p> <p>If there are curb ramp flares, are the slopes of the flares no steeper than 1:10, i.e. for every inch of height change there are at least 10 inches of flare run? [406.3]</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p> <p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p>		
<p>6.12 If the landing at the top is less than 36 inches long, are there curb ramp flares? [406.4]</p> <p>Are the slopes of the flares no greater than 1:12, i.e. for every inch of height change there are at least 12 inches of flare run? [406.4]</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p>		

ADA Checklist for Existing Facilities – Parking

City of Grand Rapids ADA Transition Plan

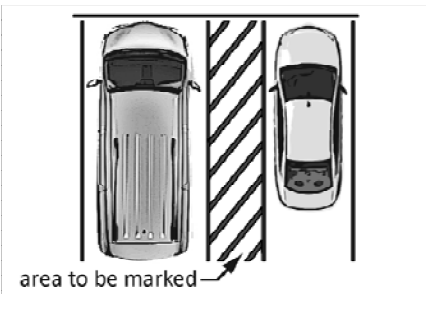
Building: Prof Building East

Location: Block 16


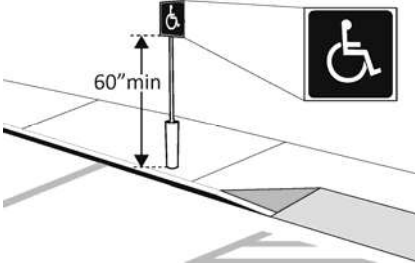
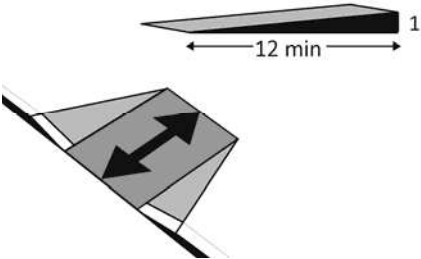
Date: 9/27/19

Evaluated By: Dom DeGuseppi


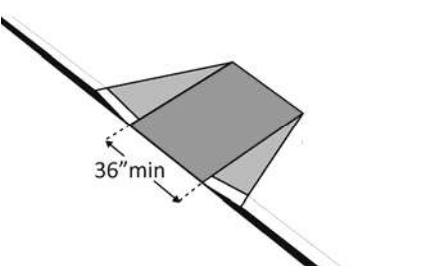
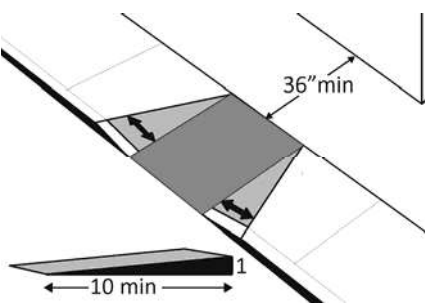

Priority 6 – Parking Lots

<p>6.1 Are an adequate number of accessible spaces provided? [208.2]</p>	<p><input checked="" type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Total #: 53 Accessible #: 3</p>	<table border="1"> <thead> <tr> <th>Total Spaces</th> <th>Accessible Spaces</th> </tr> </thead> <tbody> <tr> <td>1 - 25</td> <td>1</td> </tr> <tr> <td>26 - 50</td> <td>2</td> </tr> <tr> <td>51 - 75</td> <td>3</td> </tr> <tr> <td>76 - 100</td> <td>4</td> </tr> <tr> <td colspan="2">100+ see 2010 Standards 208.2</td> </tr> </tbody> </table>	Total Spaces	Accessible Spaces	1 - 25	1	26 - 50	2	51 - 75	3	76 - 100	4	100+ see 2010 Standards 208.2		
Total Spaces	Accessible Spaces														
1 - 25	1														
26 - 50	2														
51 - 75	3														
76 - 100	4														
100+ see 2010 Standards 208.2															
<p>6.2 Are accessible spaces at least 8 feet wide with an access aisle at least 8 feet wide? [502.2, 502.3]</p> <p>Note: Two spaces may share an access aisle. Check state/local requirements; some specify that each space have its own aisle.</p>	<p><input checked="" type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement: 10'</p>														
<p>6.3 Are the access aisles marked with signage and surface painting so as to discourage parking in them? [502.3.3]</p> <p>Note: The marking method and color may be addressed by state/local</p>	<p><input checked="" type="checkbox"/> Yes <input type="checkbox"/> No</p>														

ADA Checklist for Existing Facilities – Parking Lots

	requirements.			
6.4	Is the slope of the accessible parking spaces and access aisles no steeper than 1:48 in all directions? [502.4]	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No Measurement: .2-3.1%		Slopes varied
6.5	Do the access aisles adjoin an accessible route? [502.3]	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> NA		
6.6	Are accessible spaces identified with a sign that includes the International Symbol of Accessibility? Is the bottom of the sign at least 60 inches and not greater than 66 inches above the ground? [502.6]	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No Measurement:		Some signs are 52" and some are 84" Some signs are aligned with no parking spots/crosshatch
6.7	Of the total parking spaces, are the accessible spaces located on the closest accessible route to the accessible entrance(s)? [208.3.1]	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No		
Curb Ramps <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No				
6.8	Is the running slope of the curb ramp no steeper than 1:12, i.e. for every inch of height change there are at least 12 inches of curb ramp run? [406.1, 405.2]	<input type="checkbox"/> Yes <input type="checkbox"/> No Measurement:		

ADA Checklist for Existing Facilities – Parking Lots

<p>6.9 Is the cross slope of the curb ramp, excluding flares, no steeper than 1:48? [406.1, 405.3]</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p>		
<p>6.10 Is the curb ramp, excluding flares, at least 36 inches wide? [406.1, 405.5]</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p>		
<p>6.11 At the top of the curb ramp is there a level landing (slope no steeper than 1:48 in all directions) that is at least 36 inches long and at least as wide as the curb ramp? [406.4]</p> <p>If there are curb ramp flares, are the slopes of the flares no steeper than 1:10, i.e. for every inch of height change there are at least 10 inches of flare run? [406.3]</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p> <p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p>		
<p>6.12 If the landing at the top is less than 36 inches long, are there curb ramp flares? [406.4]</p> <p>Are the slopes of the flares no greater than 1:12, i.e. for every inch of height change there are at least 12 inches of flare run? [406.4]</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p>		

ADA Checklist for Existing Facilities – Parking

City of Grand Rapids ADA Transition Plan

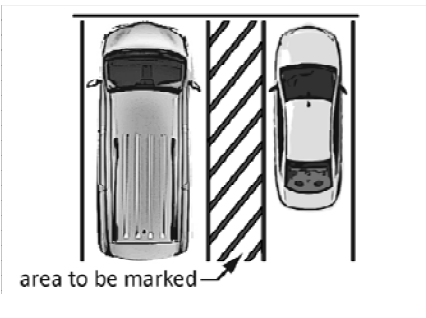
Building: West Mall Lot

Location: Block 33


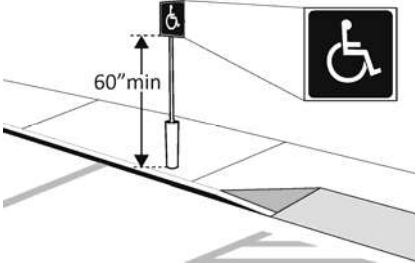
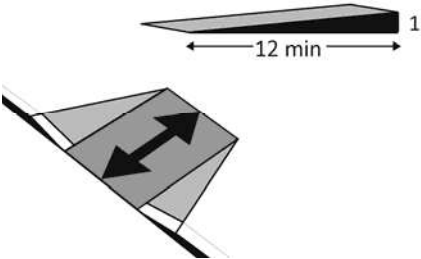
Date: 9/26/19

Evaluated By: Dom DeGuseppi


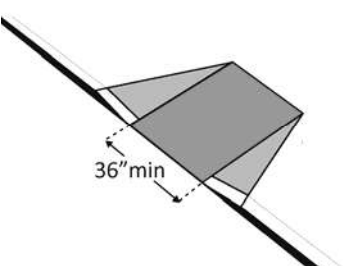
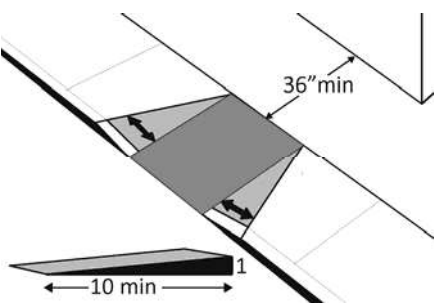
Priority 6 – Parking Lots

<p>6.1 Are an adequate number of accessible spaces provided? [208.2]</p>	<p><input checked="" type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Total #: 32 Accessible #: 2</p>	<table border="1"> <thead> <tr> <th>Total Spaces</th> <th>Accessible Spaces</th> </tr> </thead> <tbody> <tr> <td>1 - 25</td> <td>1</td> </tr> <tr> <td>26 - 50</td> <td>2</td> </tr> <tr> <td>51 - 75</td> <td>3</td> </tr> <tr> <td>76 - 100</td> <td>4</td> </tr> <tr> <td colspan="2">100+ see 2010 Standards 208.2</td> </tr> </tbody> </table>	Total Spaces	Accessible Spaces	1 - 25	1	26 - 50	2	51 - 75	3	76 - 100	4	100+ see 2010 Standards 208.2		
Total Spaces	Accessible Spaces														
1 - 25	1														
26 - 50	2														
51 - 75	3														
76 - 100	4														
100+ see 2010 Standards 208.2															
<p>6.2 Are accessible spaces at least 8 feet wide with an access aisle at least 8 feet wide? [502.2, 502.3]</p> <p>Note: Two spaces may share an access aisle. Check state/local requirements; some specify that each space have its own aisle.</p>	<p><input checked="" type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement: 8'</p>														
<p>6.3 Are the access aisles marked with signage and surface painting so as to discourage parking in them? [502.3.3]</p> <p>Note: The marking method and color may be addressed by state/local</p>	<p><input checked="" type="checkbox"/> Yes <input type="checkbox"/> No</p>														

ADA Checklist for Existing Facilities – Parking Lots

	requirements.			
6.4	Is the slope of the accessible parking spaces and access aisles no steeper than 1:48 in all directions? [502.4]	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No Measurement: .9-1.3%		
6.5	Do the access aisles adjoin an accessible route? [502.3]	<input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> NA		
6.6	Are accessible spaces identified with a sign that includes the International Symbol of Accessibility? Is the bottom of the sign at least 60 inches and not greater than 66 inches above the ground? [502.6]	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No Measurement: 62"		
6.7	Of the total parking spaces, are the accessible spaces located on the closest accessible route to the accessible entrance(s)? [208.3.1]	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No		
Curb Ramps <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No				
6.8	Is the running slope of the curb ramp no steeper than 1:12, i.e. for every inch of height change there are at least 12 inches of curb ramp run? [406.1, 405.2]	<input type="checkbox"/> Yes <input type="checkbox"/> No Measurement:		

ADA Checklist for Existing Facilities – Parking Lots

<p>6.9 Is the cross slope of the curb ramp, excluding flares, no steeper than 1:48? [406.1, 405.3]</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p>		
<p>6.10 Is the curb ramp, excluding flares, at least 36 inches wide? [406.1, 405.5]</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p>		
<p>6.11 At the top of the curb ramp is there a level landing (slope no steeper than 1:48 in all directions) that is at least 36 inches long and at least as wide as the curb ramp? [406.4]</p> <p>If there are curb ramp flares, are the slopes of the flares no steeper than 1:10, i.e. for every inch of height change there are at least 10 inches of flare run? [406.3]</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p> <p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p>		
<p>6.12 If the landing at the top is less than 36 inches long, are there curb ramp flares?</p> <p>Are the slopes of the flares no greater than 1:12, i.e. for every inch of height change there are at least 12 inches of flare run? [406.4]</p>	<p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p><input type="checkbox"/> Yes <input type="checkbox"/> No</p> <p>Measurement:</p>	